

ENF Environmental Notification Form

For Office Use Only
 Executive Office of Environmental Affairs

EOEA No.: **14391**
 MEPA Analyst: **Purvi Patel**
 Phone: 617-626-**1029**

The information requested on this form must be completed to begin MEPA Review in accordance with the provisions of the Massachusetts Environmental Policy Act, 301 CMR 11.00.

Project Name: Modifications of the Oak Bluffs Wastewater Treatment Facility to discharge treated effluent at the Martha's Vineyard Regional High School existing leaching fields.		
Street: Pennsylvania Ave. (Treatment Facility)		Sanderson Ave. (Disposal site)
Municipality: Oak Bluffs	Watershed: Islands	
Universal Transverse Mercator Coordinates: 366537.75 m E 4585982.44 m N (Disposal)		Latitude: 41-24'-51.75" N Longitude: 70-35'-48.68" W (Disposal Site)
Estimated commencement date: 10/2009		Estimated completion date: 2/2010
Approximate cost: \$760,000.00		Status of project design: 95 %complete
Proponent: Oak Bluffs Wastewater Department		
Street: Box 1526		
Municipality: Oak Bluffs	State: MA	Zip Code:
Name of Contact Person From Whom Copies of this ENF May Be Obtained: Richard J. Barbini, PE		
Firm/Agency: Schofield, Barbini & Hoehn, Inc		Street: Box 339, 12 Surveyor's Lane
Municipality: Vineyard Haven	State: MA	Zip Code: 02568
Phone: 508-693-2781	Fax: 508-693-6055	E-mail: rbarbini@sbhinc.net

Does this project meet or exceed a mandatory EIR threshold (see 301 CMR 11.03)?
 Yes X No

Has this project been filed with MEPA before?
 Yes (EOEA No. _____) X No

Has any project on this site been filed with MEPA before?
 Yes (EOEA No. _____) X No

Is this an Expanded ENF (see 301 CMR 11.05(7)) requesting:

a Single EIR? (see 301 CMR 11.06(8))	<input type="checkbox"/> Yes	X No
a Special Review Procedure? (see 301 CMR 11.09)	<input type="checkbox"/> Yes	X No
a Waiver of mandatory EIR? (see 301 CMR 11.11)	<input type="checkbox"/> Yes	X No
a Phase I Waiver? (see 301 CMR 11.11)	<input type="checkbox"/> Yes	X No

Identify any financial assistance or land transfer from an agency of the Commonwealth, including the agency name and the amount of funding or land area (in acres): None

Are you requesting coordinated review with any other federal, state, regional, or local agency?
 X Yes DEP, (Southeast Regional Office, Bureau of Resource Protection) No

List Local or Federal Permits and Approvals: None

Which ENF or EIR review threshold(s) does the project meet or exceed (see 301 CMR 11.03):

- | | | |
|---------------------------------|--|--|
| <input type="checkbox"/> Land | <input type="checkbox"/> Rare Species | <input type="checkbox"/> Wetlands, Waterways, & Tidelands |
| <input type="checkbox"/> Water | <input checked="" type="checkbox"/> Wastewater | <input type="checkbox"/> Transportation |
| <input type="checkbox"/> Energy | <input type="checkbox"/> Air | <input type="checkbox"/> Solid & Hazardous Waste |
| <input type="checkbox"/> ACEC | <input type="checkbox"/> Regulations | <input type="checkbox"/> Historical & Archaeological Resources |

Summary of Project Size & Environmental Impacts	Existing	Change	Total	State Permits & Approvals
LAND				<input type="checkbox"/> Order of Conditions <input type="checkbox"/> Superseding Order of Conditions <input type="checkbox"/> Chapter 91 License <input type="checkbox"/> 401 Water Quality Certification <input type="checkbox"/> MHD or MDC Access Permit <input type="checkbox"/> Water Management Act Permit <input type="checkbox"/> New Source Approval <input type="checkbox"/> DEP or MWRA Sewer Connection/ Extension Permit <input type="checkbox"/> Other Permits <i>(including Legislative Approvals) – Specify:</i>
Total site acreage	24+/- acres (Dis. Site)			
New acres of land altered		0		
Acres of impervious area	17	0	17	
Square feet of new bordering vegetated wetlands alteration		0		
Square feet of new other wetland alteration		0		
Acres of new non-water dependent use of tidelands or waterways		0		
STRUCTURES				
Gross square footage	150,000	0	150,000	
Number of housing units	0	0	0	
Maximum height (in feet)	30'	0	30	
TRANSPORTATION				
Vehicle trips per day	n/a			
Parking spaces				
WATER/WASTEWATER				
Gallons/day (GPD) of water use	n/a			
GPD water withdrawal	n/a			
GPD wastewater generation/ treatment	20,000 gpd to be discharged on site			
Length of water/sewer mains (in miles)	7.0	2.6	9.6	

CONSERVATION LAND: Will the project involve the conversion of public parkland or other Article 97 public natural resources to any purpose not in accordance with Article 97?

Yes (Specify _____) No

Will it involve the release of any conservation restriction, preservation restriction, agricultural preservation restriction, or watershed preservation restriction?

Yes (Specify _____) No

RARE SPECIES: Does the project site include Estimated Habitat of Rare Species, Vernal Pools, Priority Sites of Rare Species, or Exemplary Natural Communities?

Yes (Specify _____) No

HISTORICAL /ARCHAEOLOGICAL RESOURCES: Does the project site include any structure, site or district listed in the State Register of Historic Place or the inventory of Historic and Archaeological Assets of the Commonwealth?

Yes (Specify _____) No

If yes, does the project involve any demolition or destruction of any listed or inventoried historic or archaeological resources?


Yes (Specify _____) No

AREAS OF CRITICAL ENVIRONMENTAL CONCERN: Is the project in or adjacent to an Area of Critical Environmental Concern?

Yes (Specify _____) No

PROJECT DESCRIPTION: The project description should include (a) a description of the project site, (b) a description of both on-site and off-site alternatives and the impacts associated with each alternative, and (c) potential on-site and off-site mitigation measures for each alternative (*You may attach one additional page, if necessary.*)

1. The project consists of transporting 20,000 gallons per day of treated effluent from the existing Oak Bluffs treatment plant and discharging into the existing Title 5 leaching field serving the High School.
2. Approval to transport the sewage from the High School to the treatment plant has been received.
3. The existing septic system excluding the leaching field will be abandoned.
4. The existing leaching is in a wooded area and it will not be altered.
5. The only alternatives to this project are
 - A. An alternative disposal site outside of the Zone II or
 - B. Leave the High School on the Existing Title 5 Septic System

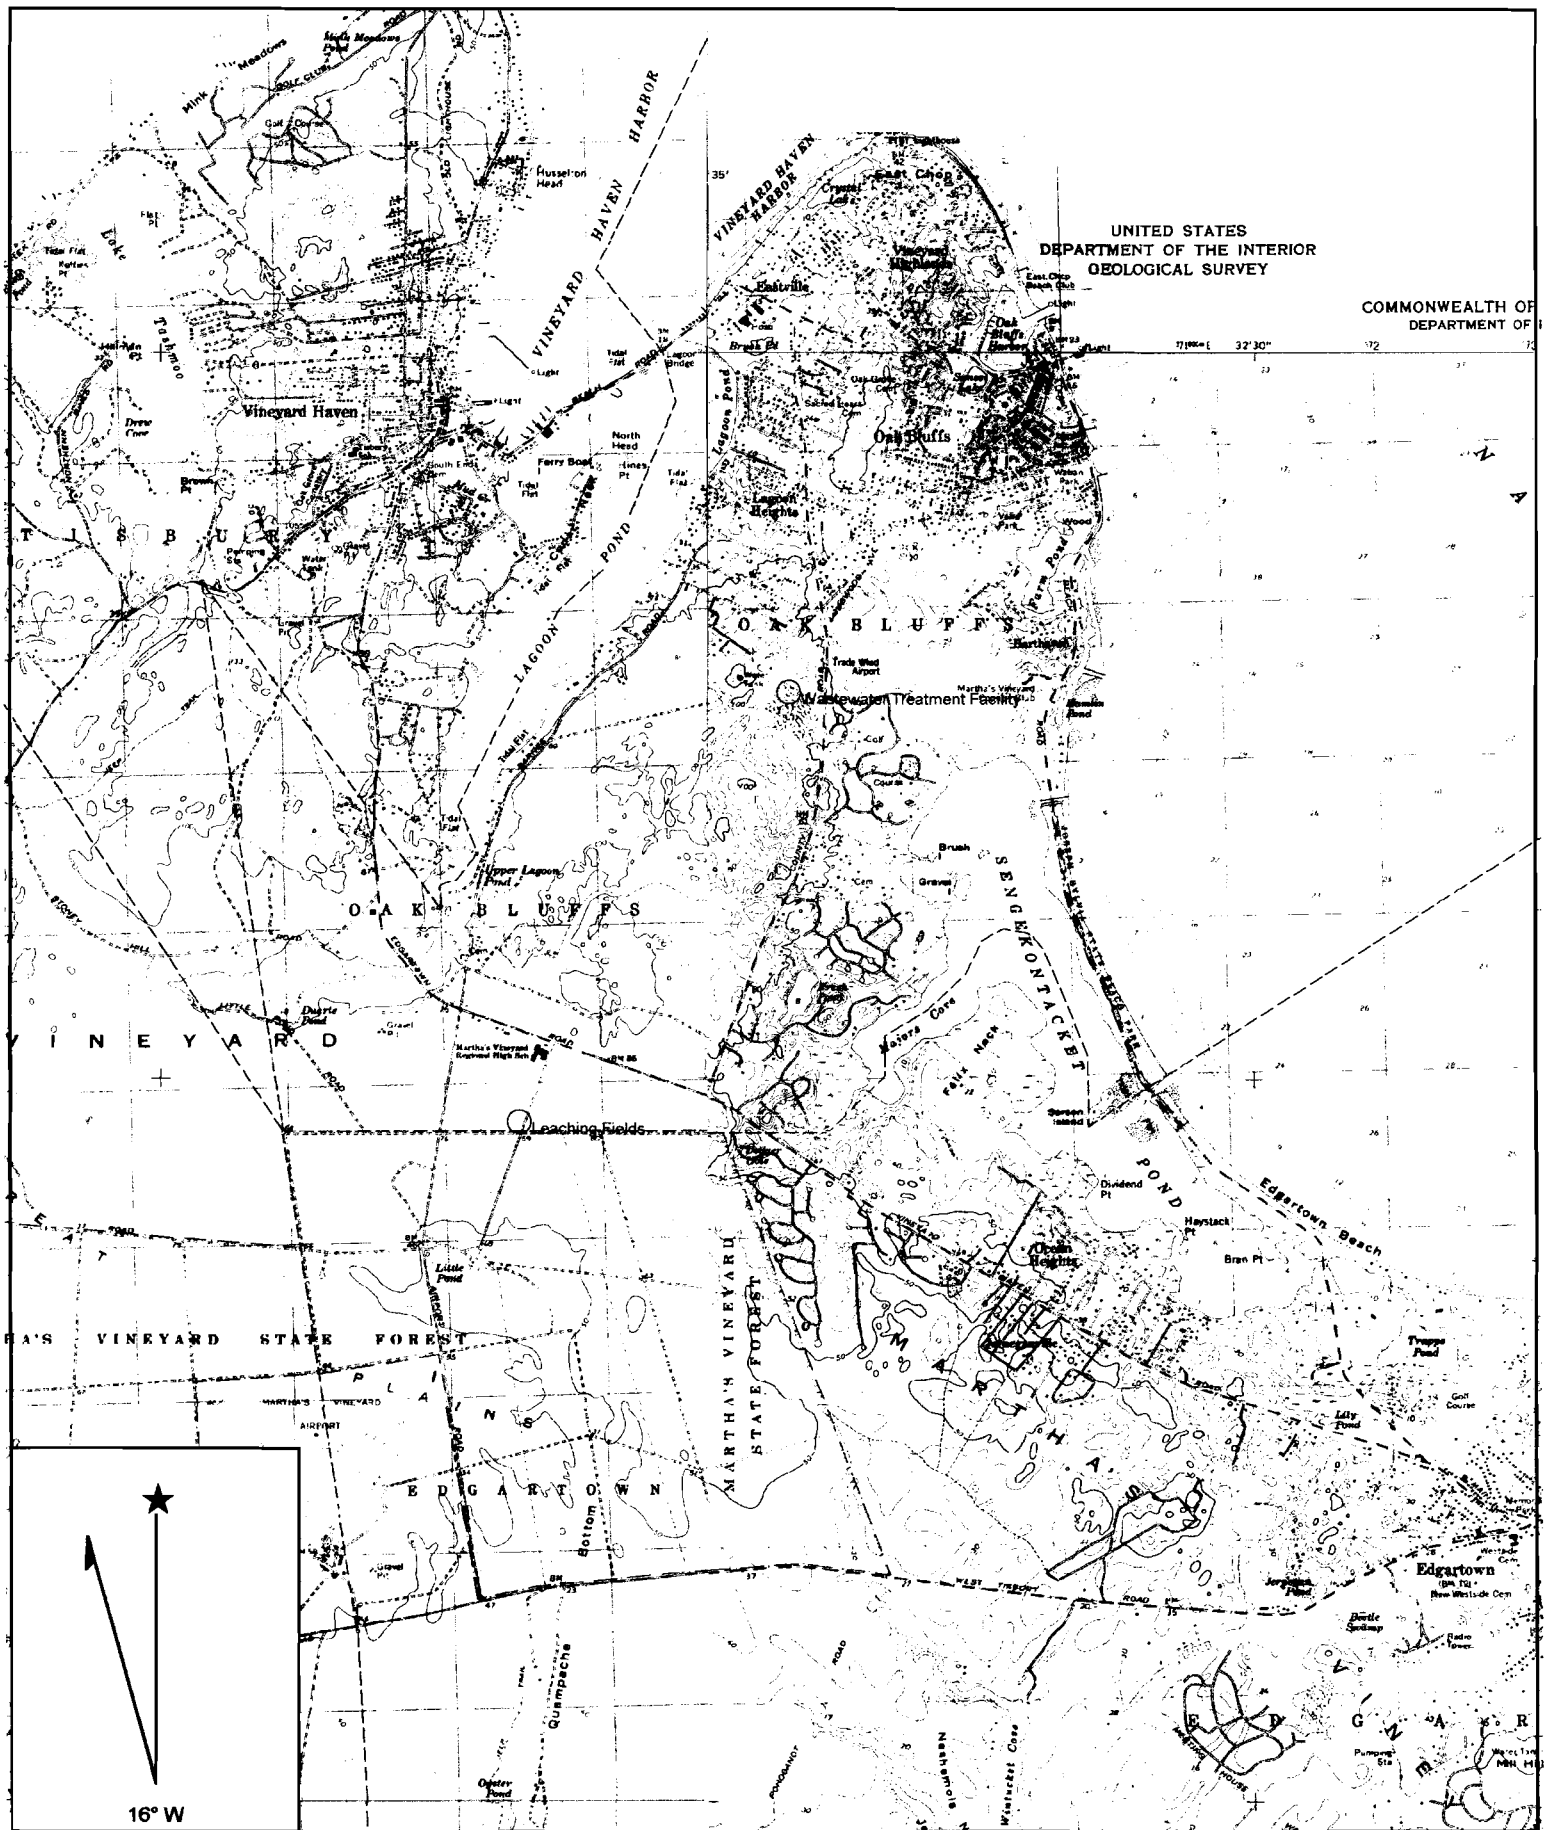

Name: EDGARTOWN
Date: 2/26/2009
Scale: 1 inch equals 4000 feet

Location: 041° 25' 32.6" N 070° 34' 42.0" W