

## Private Well Sampling Monthly Summary Princeton PFAS Release RTN 2-21072

**TO:** Rebecca Buswell; MassDEP  
**FROM:** Jeffrey Arps, LSP; Tighe & Bond  
**COPY:** Sherry Patch; Princeton Town Administrator  
**DATE:** October 14, 2020

This memo is intended to provide an update to MassDEP on the status of ongoing assessment and response actions as required in MassDEP's January 24, 2020 IRA Plan Conditional Approval. Table 1 and Table 2, attached for reference, provide a summary of PFAS results collected to date and the status of POET system installations.

### Summary of Recent Response Actions

- An IRA Status Report was submitted on September 10, 2020.
- Radius 1 sampling is complete. The majority of Radius 1 sampling was completed in December 2019 and January 2020. The only remaining property in Radius 1 was 22 Mountain Road, which was sampled on July 31, 2020.
- All locations identified for sampling in Radius 2 were sampled in January and February 2020.
- Locations identified for sampling in Radius 3 were sampled in February and March 2020 with the exception of the following locations which have not been sampled as of this submittal:
  - 35 Hubbardston – No contact with owner
  - 39 Hubbardston – Vacant (foreclosure)
  - 27 Prospect – Vacant
  - 31 Prospect – Vacant
- Locations identified for sampling in Radius 4 were sampled in April and May 2020. Access to 15 and 18 Radford Road was obtained and both locations were sampled on September 18, 2020. Based on those results 15 Radford Road requires the installation of a treatment system. The installation is scheduled to take place on October 21, 2020. The only location inside Radius 4 that has not been sampled is 38 Radford Road. Based on a discussion with the owner, there are two wells on the property (an old shallow dug well [not in use] and a deeper drilled well [house supply well]); however, neither are operational at this time. The owner reports that the house is being prepared to sell and once the pump for the drilled well is operational, we will be contacted to collect a sample.
- Based on the results received to date from Radius 4, the following new properties were identified for sampling. The town sent notices regarding the need to sample to the owners of these properties on July 29, 2020.
  - 55 Merriam
  - 58 Merriam
  - 6 Connor Lane

The wells at 58 Merriam Road and 6 Connor Lane have been sampled. The result for 6 Connor Lane was non-detect and the results for 58 Merriam are currently pending from the laboratory. Efforts to gain access to 55 Merriam Road are ongoing.

- Based on the performance of POET systems to date, the Town submitted an IRA Modification on August 18, 2020 to request a reduction in POET monitoring frequency from monthly to quarterly at locations where at least three months of data have been collected, showing that the system is removing PFAS. To date, breakthrough of the primary carbon vessels has not been detected at any home with a POET system.
- POET system monitoring is being completed monthly at 22 Mountain Road. Once the POET system is installed at 15 Radford Road, that location will also be sampled monthly. This monitoring schedule will be modified to quarterly once three months of data demonstrating system efficacy have been received. All other POET locations are now on the quarterly sampling schedule.
- The permit application for a POET at 14 Mountain Road is in-process.
- Quarterly sampling at those locations previously sampled is complete with the exception of 2 Radford, which has a new owner. We will contact the owner as soon as contact information is received.
- The Town of Princeton was approved for up to 75 water samples under the PFAS Free Sampling Initiative. Through July 31, 2020, 59 samples have been billed to MassDEP under the initiative, leaving a balance of 16 samples.

J:\P\0534 Princeton PSB\PFAS 2019\MADEP\Monthly Submittals\October 2020\Monthly Update Memo 10\_20.docx

# FIGURE 2 ORTHOGRAPH SITE PLAN

## LEGEND

### Total Regulated PFAS Concentrations in Parts-Per-Trillion (ppt)

- Greater Than 100
- Greater Than 20 But Less Than 100
- Greater Than 2 But Less Than 20
- Non Detect (<2)
- Non-Community Transient Public Water Supply



### 500' Foot Radii Over Time

- Start of Project
- Current Status (2020/10/15)

### Affected Property Labels:

- (Point of Entry Treatment, if present)
- Address
- PFAS 6-Compound Total

## LOCUS MAP

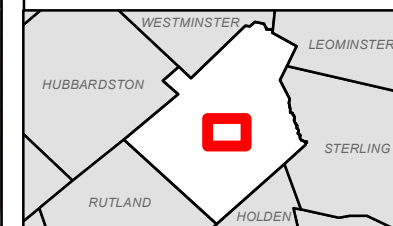


## NOTES

1. Based on Google Imagery (2017)
2. 500' Buffer based on a 50' buffer of building structures. Well locations are assumed to be within 50' of each home.
3. Abbreviation Dictionary:  
 "ALLEN HILL RD": "A-HIL"  
 "BOYLSTON AVE": "BYLN"  
 "GREGORY HILL RD": "G-HIL"  
 "HUBBARDSTON RD": "HUB"  
 "MOUNTAIN RD": "MTN"  
 "PROSPECT ST": "PRSP"  
 "RADFORD RD": "RFRD"  
 "WORCESTER RD": "WORC"  
 "MERRIAM": "MRIM"  
 "GOODNOW": "GDNW"  
 "CONOR": "CONR"

Princeton, Massachusetts

October 2020

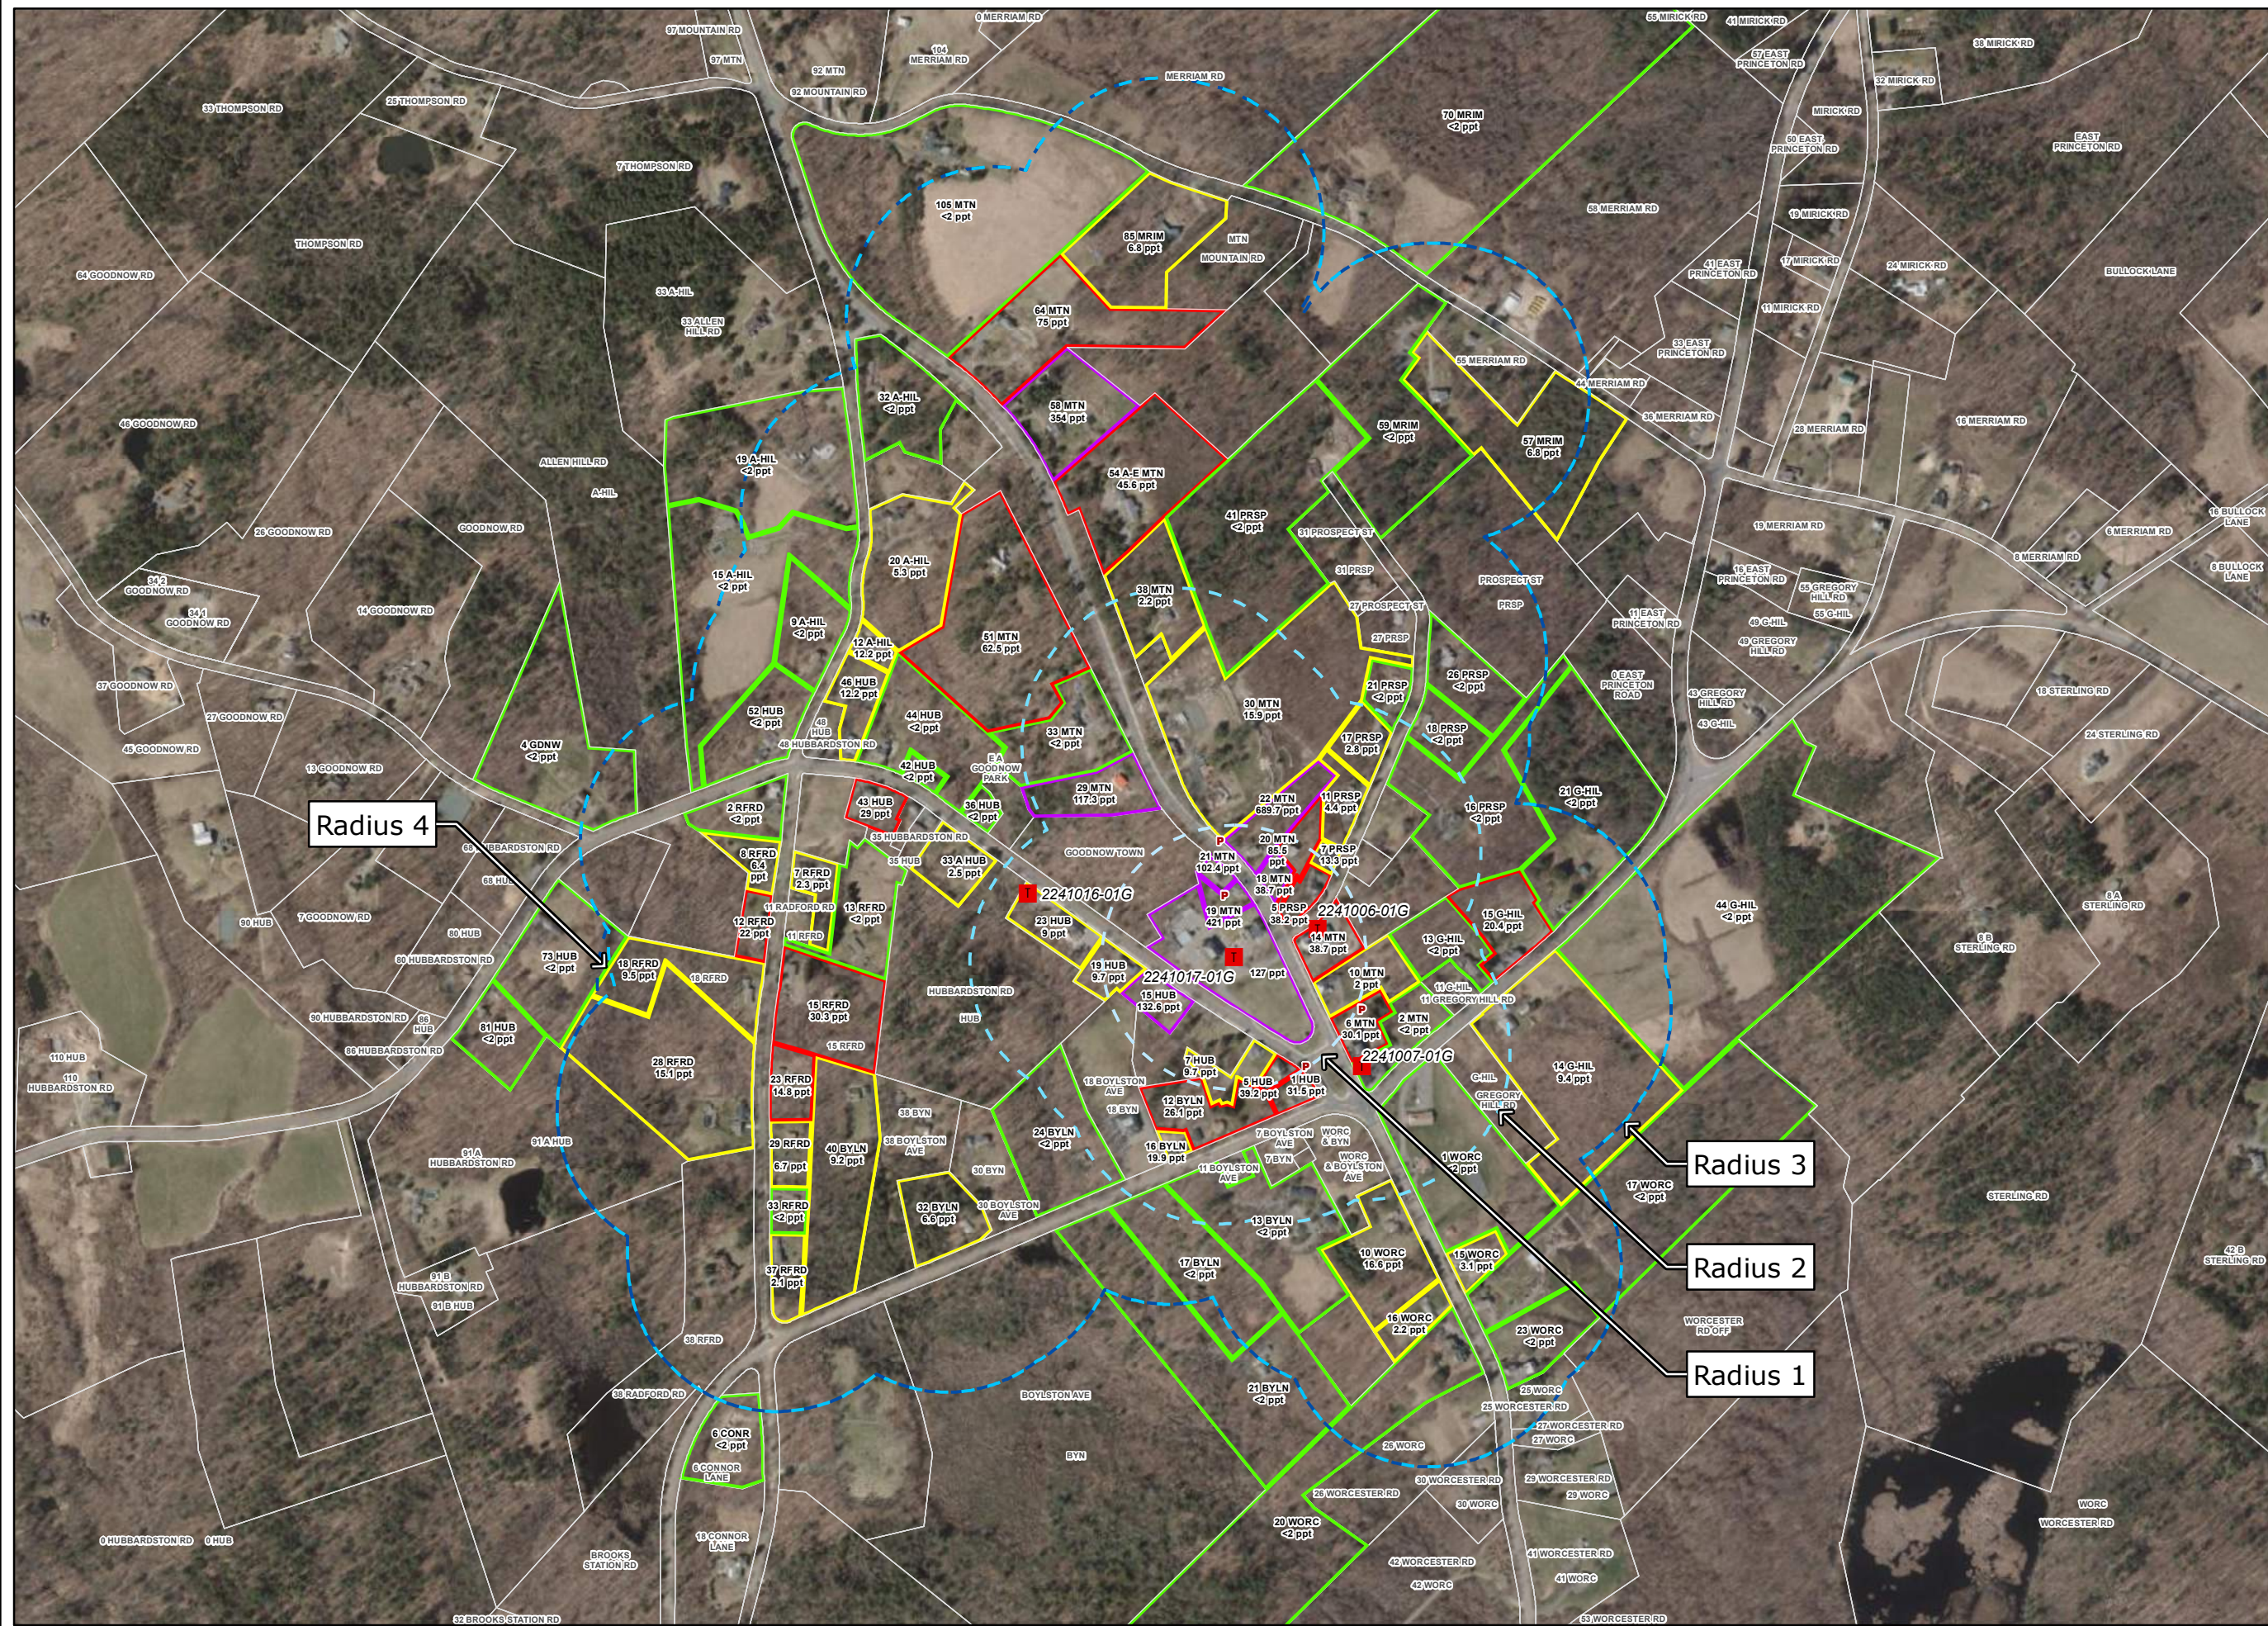

**MONTHLY PRIVATE WELL SAMPLING SUMMARY  
PRINCETON PFAS RELEASE  
PRINCETON MASSACHUSETTS  
RTN 2-21072**

Sample Location	Date Sampled	Date Data Received	Total Regulated PFAS (ppt)	Comments
Town Well	9/5/2019	9/25/2019	124.7	
	9/27/2019	10/21/2019	100.2	
	1/8/2020	2/27/2020	230.1	
9 Allen Hill	2/12/2020	2/28/2020	<2.0	Round 3 location
	7/23/2020	8/10/2020	<2.0	Quarterly
12 Allen Hill	2/14/2020	2/27/2020	12.2	Round 3 location
	7/27/2020	8/12/2020	<2.0	Quarterly
15 Allen Hill	4/28/2020	5/14/2020	<2.0	Round 4 Location
				Quarterly
19 Allen Hill	4/28/2020	5/14/2020	<2.0	Round 4 Location
				Quarterly
20 Allen Hill	5/8/2020	5/19/2020	5.3	Round 4 Location
				Quarterly
32 Allen Hill	2/2/2020	2/6/2020	<2.0	
	7/22/2020	8/10/2020	<2.0	Quarterly
6 Connor Lane	8/31/2020	9/17/2020	<2.0	Round 4A Location
	1/27/2020	2/13/2020	23.2	Field Blank contained PFAS, concentration confirmed by running duplicate, see table
7 Boylston	POET INSTALLED 3/1/20			
	3/17/2020	4/1/2020	29	1st system sample (mid- and effluent ND)
	5/1/2020	5/18/2020	18	(mid- and effluent ND)
	6/18/2020	7/7/2020	29.6	(mid- and effluent ND)
	7/29/2020	8/19/2020	27.1	(mid- and effluent ND)
	1/13/2020	1/29/2020	26.1	
12 Boylston	POET INSTALLED 3/20/20			
	5/1/2020	5/13/2020	25.6	1st system sample
	6/23/2020	7/7/2020	31.2	(mid- and effluent ND)
	7/31/2020	8/17/2020	27.6	(mid- and effluent ND)
13 Boylston	1/8/2020	1/21/2020	<2.0	
	5/28/2020	6/15/2020	<2.0	Quarterly Sample
16 Boylston				Quarterly
	1/9/2020	1/21/2020	19.9	Very close to standard
	5/28/2020	6/15/2020	19.6	Quarterly Sample
17 Boylston				Quarterly
	1/8/2020	1/21/2020	<2.0	
	5/28/2020	6/15/2020	<2.0	Quarterly Sample
21 Boylston	2/19/2020	2/27/2020	<2.0	Round 3 Location
	7/22/2020	8/10/2020	<2.0	Quarterly Sample
24 Boylston	1/9/2020	1/21/2020	<2.0	
	5/29/2020	6/15/2020	<2.0	Quarterly Sample
32 Boylston				Quarterly
	5/28/2020	6/15/2020	6.6	Round 4 Location
40 Boylston				Quarterly
	4/28/2020	5/14/2020	9.2	Round 4 Location
4 Goodnow				Quarterly
	4/28/2020	5/18/2020	<2.0	Round 4 Location
9 Gregory Road				Quarterly
	2/1/2020	2/7/2020	<2.0	Outside of radius
11 Gregory Hill	1/22/2020	2/6/2020	<2.0	
	5/29/2020	6/15/2020	<2.0	Quarterly Sample
				Quarterly
13 Gregory Hill				Quarterly
	1/10/2020	1/23/2020	<2.0	
	5/29/2020	6/15/2020	<2.0	Quarterly Sample
14 Gregory Hill				Quarterly
	1/9/2020	1/21/2020	9.4	
	5/29/2020	6/15/2020	11.4	Quarterly Sample
15 Gregory Hill				Quarterly
	1/13/2020	1/23/2020	20.4	
	POET INSTALLED 2/26/20			
	3/11/2020	3/18/2020	14.2	1st system sample (mid- and effluent ND)
21 Gregory Hill	6/23/2020	7/7/2020	<2.0	(mid- and effluent ND)
	7/31/2020	8/17/2020	<2.0	(mid- and effluent ND)
	2/28/2020	3/6/2020	<2.0	Round 3 Location
44 Gregory Hill	9/18/2020	10/7/2020	<2.0	Quarterly Sample
	2/5/2020	2/14/2020	<2.0	Round 3 Location
	7/22/2020	8/10/2020	<2.0	Quarterly Sample
1 Hubbardston	1/8/2020	1/21/2020	31.5	
	POET INSTALLED 2/26/20			
	3/11/2020	3/18/2020	28	1st system sample (mid- and effluent ND)
	5/1/2020	5/13/2020	29.8	(mid- and effluent ND)
	6/18/2020	7/7/2020	33.1	(mid- and effluent ND)
	7/29/2020	8/17/2020	31.5	(mid- and effluent ND)
5 Hubbardston	12/5/2020	12/13/2019	39.2	
	POET INSTALLED 1/28/20			
	2/5/2020	2/18/2020	34.4	1st system sample (mid- and effluent ND)
	3/5/2020	3/11/2020	18.5	(mid- and effluent ND)
	5/1/2020	5/13/2020	22.7	(mid- and effluent ND)
	6/30/2020	7/8/2020	25.1	(mid- and effluent ND)
7 Hubbardston	8/4/2020	8/21/2020	36.2	(mid- and effluent ND)
	12/5/2020	12/13/2019	9.7	
	6/5/2020	6/15/2020	11.7	Quarterly Sample
15 Hubbardston				Quarterly
	12/5/2020	12/13/2019	132.6	
	POET INSTALLED 2/11/20			
	2/26/2020	3/9/2020	90.5	1st system sample (mid- and effluent ND)
	5/1/2020	5/13/2020	120.2	(mid- and effluent ND)
19 Hubbardston	6/18/2020	7/7/2020	111	(mid- and effluent ND)
	7/30/2020	8/17/2020	114.9	(mid- and effluent ND)
	12/5/2020	12/13/2019	9.7	
23 Hubbardston	2/26/2020	3/9/2020	NA	POET installed by homeowner, EFF sample collected at homeowner request, EFF=ND
	6/5/2020	6/15/2020	5.8	Quarterly Sample, (mid- and effluent ND)
	1/10/2020	1/23/2020	9.0	
23 Hubbardston	1/27/2020	1/30/2020	8.7	resample
	5/29/2020	6/15/2020	7.4	Quarterly Sample
				Quarterly

**MONTHLY PRIVATE WELL SAMPLING SUMMARY**

**PRINCETON PFAS RELEASE  
PRINCETON MASSACHUSETTS  
RTN 2-21072**

33 Hubbardston	2/5/2020	2/17/2020	2.5	Round 3 Location
	7/23/2020	8/10/2020	4.2	Quarterly Sample
35 Hubbardston				Round 3 Location
36 Hubbardston	2/6/2020	2/14/2020	<2.0	Round 3 Location
	7/22/2020	8/7/2020	10.4	Quarterly Sample
39 Hubbardston				Vacant, Foreclosure
42 Hubbardston	2/10/2020	2/28/2020	<2	Round 3 Location
	7/23/2020	8/10/2020	15.7	Quarterly Sample
43 Hubbardston	12/12/2019	1/31/2020	29	Sampled by homeowner
	POET INSTALLED 3/20/20			
	5/8/2020	5/26/2020	29.5	1st system sample (mid- and effluent ND)
	6/23/2020	7/7/2020	31.6	(mid- and effluent ND)
44 Hubbardston	2/10/2020	2/28/2020	<2.0	Round 3 Location
	7/23/2020	8/11/2020	14.8	Quarterly Sample
46 Hubbardston	2/12/2020	2/28/2020	12.2	Round 3 Location
	7/23/2020	8/10/2020	17.4	Quarterly Sample
48 Hubbardston	2/12/2020	2/28/2020	<2.0	Round 3 Location
	7/23/2020	8/7/2020	<2.0	Quarterly Sample
52 Hubbardston	2/12/2020	2/28/2020	<2.0	Round 3 Location
	9/18/2020	10/7/2020	<2.0	Quarterly Sample
73 Hubbardston	6/5/2020	6/22/2020	<2.0	Round 4 Location
				Quarterly
81 Hubbardston	4/28/2020	5/14/2020	<2.0	Round 4 Location
55 Merriam				Quarterly
58 Merriam	10/6/2020			Round 4A Location
57 Merriam	4/28/2020	5/14/2020	6.8	Round 4 Location (Homeowner paid to have one carbon unit installed)
				Quarterly
59 Merriam	4/28/2020	5/14/2020	<2.0	Round 4 Location
70 Merriam	4/28/2020	5/14/2020	<2.0	Quarterly
85 Merriam	2/26/2020	3/6/2020	6.8	Round 4 Location
	7/22/2020	8/10/2020	8.0	Added to Round 3
105 Merriam	2/28/2020	3/6/2020	<2.0	Quarterly Sample
	7/21/2020	8/10/2020	<2.0	Added to Round 3
Mountain Road Runoff	2/27/2020	3/12/2020	3,642.3	Quarterly Sample
2 Mountain	1/7/2020	1/21/2020	<2.0	
	6/5/2020	6/15/2020	2.1	Quarterly
6 Mountain	12/5/2020	12/13/2019	30.1	Quarterly Sample
	POET INSTALLED 1/28/20			
	2/5/2020	2/18/2020	18.2	1st system sample (mid- and effluent ND)
	3/5/2020	3/12/2020	24.5	(mid- and effluent ND)
	5/8/2020	5/26/2020	20.5	(mid- and effluent ND)
	6/23/2020	7/7/2020	38.4	(mid- and effluent ND)
10 Mountain	7/29/2020	8/19/2020	16.5	
	12/9/2020	12/30/2019	2.0	
14 Mountain	6/11/2020	6/22/2020	10.9	Quarterly Sample
	1/9/2020	1/21/2020	38.7	NEEDS A POET
	1/22/2020	2/6/2020	45.1	resample
18 Mountain	5/29/2020	6/15/2020	43.3	Quarterly Sample
	1/10/2020	1/23/2020	217.4	
	POET INSTALLED 2/11/20			
	2/14/2020	3/3/2020	165.6	1st system sample (mid- and effluent ND)
	3/11/2020	3/18/2020	227.0	system sample (mid- and effluent ND)
	5/1/2020	5/13/2020	128.9	(mid- and effluent ND)
19 Mountain	6/18/2020	7/7/2020	71.1	(mid- and effluent ND)
	7/29/2020	8/19/2020	65.4	(mid- and effluent ND)
	12/4/2020	12/13/2019	421	
	POET INSTALLED 1/10/20			
	1/13/2020	1/30/2020	109.5	1st system sample (mid- and effluent ND)
	1/17/2020	1/30/2020	345.6	2nd system sample (mid- and effluent ND)
	1/31/2020	2/7/2020	73.0	3rd system sample (mid- and effluent ND)
20 Mountain	3/3/2020	3/17/2020	70.0	(mid- and effluent ND)
	5/8/2020	5/26/2020	119.2	(mid- and effluent ND)
	6/18/2020	7/7/2020	595.7	(mid- and effluent ND)
	7/29/2020	8/12/2020	139.0	(mid- and effluent ND)
	1/10/2020	1/23/2020	86	
21 Mountain	POET INSTALLED 2/11/20			
	2/14/2020	2/26/2020	106	1st system sample (mid- and effluent ND)
	3/17/2020	4/1/2020	112	(mid- and effluent ND)
	6/18/2020	7/7/2020	169.2	(mid- and effluent ND)
22 Mountain	7/29/2020	8/19/2020	158.3	(mid- and effluent ND)
	12/5/2019	12/13/2019	102.4	
	POET INSTALLED 1/21/20			
	1/24/2020	1/30/2020	88.6	1st system sample (mid- and effluent ND)
	1/31/2020	2/7/2020	77.7	2nd system sample (mid- and effluent ND)
	2/7/2020	2/18/2020	61.5	3rd system sample (mid- and effluent ND)
	3/17/2020	4/1/2020	88.9	(mid- and effluent ND)
	5/8/2020	5/26/2020	51.4	(mid- and effluent ND)
6/30/2020	7/8/2020	58.0	(mid- and effluent ND)	
29 Mountain	7/31/2020	8/17/2020	66.5	(mid- and effluent ND)
	7/31/2020	8/17/2020	689.7	
30 Mountain	POET INSTALLED 9/3/20			
	9/10/2020	9/29/2020	82.3	1st system sample (mid- and effluent ND)
	1/8/2020	1/21/2020	117.3	
	POET INSTALLED 2/24/20			
	3/11/2020	3/18/2020	84	1st system sample (mid- and effluent ND)
33 Mountain	5/8/2020	6/2/2020	52.4	MID (ND), EFF (40.5), EFF DUP (25.2), resampled 6/3 EFF (ND)
	6/30/2020	7/14/2020	51	MID (ND), EFF (50). Site visit determined that homeowner opened the wrong valve allowing raw water into eff sample port
	7/14/2020	7/29/2020	-	Effluent only (ND)
	7/29/2020	8/17/2020	55.8	(mid- and effluent ND)
38 Mountain	1/27/2020	1/30/2020	15.9	
	6/5/2020	6/22/2020	12.6	Quarterly Sample
33 Mountain				Quarterly
38 Mountain	2/7/2020	2/14/2020	<2.0	
	7/22/2020	7/22/2020	<2.0	Quarterly Sample
38 Mountain	2/14/2020	2/27/2020	2.2	Round 3 Location
	7/21/2020	7/21/2020	5.4	Quarterly Sample

**MONTHLY PRIVATE WELL SAMPLING SUMMARY**

**PRINCETON PFAS RELEASE**

**PRINCETON MASSACHUSETTS**

**RTN 2-21072**

51 Mountain	2/12/2020	2/28/2020	62.5	
	POET INSTALLED 5/1/20			
	5/28/2020	6/15/2020	64.4	1st system sample (mid- and effluent ND)
	6/23/2020	7/7/2020	60.6	(mid- and effluent ND)
54 Mountain	7/31/2020	8/17/2020	68.2	(mid- and effluent ND)
	2/26/2020	3/6/2020	45.6	NEEDS A POET
	POET INSTALLED 6/2/20			
	6/22/2020	7/7/2020	58.4	1st system sample (mid- and effluent ND)
58 Mountain	8/4/2020	8/21/2020	53.9	(mid- and effluent ND)
	9/2/2020	9/23/2020	55.3	(mid- and effluent ND)
	2/26/2020	3/6/2020	354	NEEDS A POET
	POET INSTALLED 7/7/20			
64 Mountain	7/14/2020	7/30/2020	383	1st system sample (mid- and effluent ND)
	7/31/2020	8/17/2020	62.5	(mid- and effluent ND)
	8/31/2020	9/22/2020		(mid- and effluent ND)
	1/30/2020	2/5/2020	75	Outside Radius (homeowner pregnant, sampled as courtesy with 3 day rush)
5 Prospect	POET INSTALLED 2/18/20			
	3/3/2020	3/12/2020	89.5	1st system sample
	5/8/2020	5/26/2020	69.2	(mid- and effluent ND)
	6/18/2020	7/7/2020	87.3	(mid- and effluent ND)
	7/29/2020	8/19/2020	10.3	(mid- and effluent ND)
7 Prospect	1/13/2020	1/16/2020	38.2	(mid- and effluent ND)
	POET INSTALLED 1/21/20			
	1/23/2020	2/6/2020	9.6	1st system sample (mid- and effluent ND)
	1/31/2020	2/7/2020	2.5	(mid- and effluent ND)
	2/7/2020	2/18/2020	2.4	(mid- and effluent ND)
11 Prospect	6/18/2020	7/7/2020	9.8	(mid- and effluent ND)
	7/27/2020	8/12/2020	8.2	(mid- and effluent ND)
	12/9/2019	12/30/2019	13.3	
16 Prospect	6/5/2020	6/15/2020	17.0	Quarterly Sample
	10/8/2020			Quarterly
	1/8/2020	1/21/2020	4.4	
17 Prospect	2/20/2020	2/26/2020	5.8	POET installed by homeowner, INF/MID/EFF samples collected at homeowner request, (mid- and effluent ND)
	9/10/2020	9/29/2020	7.1	Quarterly
	1/22/2020	2/7/2020	<2.0	
18 Prospect	6/5/2020	6/15/2020	<2.0	Quarterly Sample
	1/8/2020	1/21/2020	2.8	
	6/5/2020	6/15/2020	<2.0	Quarterly Sample
21 Prospect	1/8/2020	1/21/2020	<2.0	
	6/5/2020	6/15/2020	<2.0	Quarterly Sample
	1/8/2020	1/21/2020	<2.0	
26 Prospect	6/5/2020	6/15/2020	<2.0	Quarterly Sample
	2/5/2020	2/14/2020	<2.0	No contact info, left flyer on 1/21, certified letter sent 1/28, homeowner reached out on 2/3.
	7/22/2020	8/10/2020	<2.0	Quarterly Sample
27 Prospect	2/6/2020	2/14/2020	<2.0	Round 3 Location
	7/23/2020	8/11/2020	<2.0	Quarterly Sample
				Round 3 Location
31 Prospect				Vacant property, Condemned
	5/15/2020	6/1/2020	<2.0	Round 4 Location
				Quarterly
2 Radford	2/19/2020	2/26/2020	<2.0	Round 3 Location
	2/28/2020	3/6/2020	2.3	Round 3 Location
	7/21/2020	8/10/2020	5.9	Quarterly Sample
7 Radford	2/28/2020	3/6/2020	6.4	Round 3 Location
	7/21/2020	8/10/2020	7.2	Quarterly Sample
	2/14/2020	2/27/2020	5	Round 3 Location
8 Radford	7/22/2020	8/7/2020	6.2	Quarterly Sample
	5/1/2020	5/14/2020	22.5	NEEDS A POET
	POET INSTALLED 6/16/20			
12 Radford	6/30/2020	7/14/2020	20.5	1st system sample (mid- and effluent ND)
	7/31/2020	8/17/2020	23.2	(mid- and effluent ND)
	8/31/2020	9/23/2020	25.7	(mid- and effluent ND)
	3/4/2020	3/16/2020	<2.0	Round 3 Location
13 Radford	7/21/2020	8/6/2020	<2.0	Quarterly Sample
	9/18/2020	10/7/2020	30.3	Round 4 Location, NEEDS A POET
	9/18/2020	10/7/2020	9.5	Round 4 Location
15 Radford	7/22/2020	8/7/2020	14.8	Round 4 Location
	1/30/2020	2/5/2020	15.1	
	7/21/2020	8/10/2020	8.6	Quarterly Sample
28 Radford	3/17/2020	4/1/2020	6.7	Round 4 Location
	7/21/2020	8/10/2020	5.2	Quarterly Sample
	5/29/2020	6/15/2020	<2.0	Round 4 Location
29 Radford	10/8/2020			Quarterly
	4/28/2020	5/14/2020	2.1	Round 4 Location
	10/8/2020			Quarterly
33 Radford				Round 4 Location
	1/7/2020	1/21/2020	<2.0	
	6/11/2020	6/22/2020	2.5	Quarterly Sample
10 Worcester				Quarterly
	1/9/2020	1/21/2020	16.6	
	6/11/2020	6/22/2020	3.0	Quarterly Sample
15 Worcester				Quarterly
	3/6/2020	3/16/2020	3.1	Round 3 Location
	7/21/2020	8/6/2020	3.1	Quarterly Sample
16 Worcester	2/5/2020	2/14/2020	2.2	Round 3 Location
	7/29/2020	8/17/2020	2.6	Quarterly Sample
	2/10/2020	2/14/2020	<2.0	Round 3 Location
17 Worcester	7/21/2020	8/6/2020	<2.0	Quarterly Sample
	3/17/2020	4/1/2020	<2.0	Round 3 Location
	7/21/2020	8/6/2020	<2.0	Quarterly Sample
20 Worcester	2/5/2020	2/14/2020	<2.0	Round 3 Location
	7/21/2020	8/6/2020	<2.0	Quarterly Sample
	2/5/2020	2/14/2020	<2.0	Round 3 Location
23 Worcester	7/21/2020	8/6/2020	<2.0	Quarterly Sample

## POET SYSTEM STATUS

Locations >20 ppt	System Status	Date Installed
7 Boylston	POET INSTALLED	3/1/2020
12 Boylston	POET INSTALLED	3/20/2020
15 Gregory Hill	POET INSTALLED	2/26/2020
1 Hubbardston	POET INSTALLED	2/26/2020
5 Hubbardston	POET INSTALLED	1/28/2020
15 Hubbardston	POET INSTALLED	2/10/2020
43 Hubbardston	POET INSTALLED	3/20/2020
6 Mountain	POET INSTALLED	1/28/2020
14 Mountain	NEEDS A POET	
18 Mountain	LARGE POET INSTALLED	2/10/2020
19 Mountain	LARGE POET INSTALLED	1/10/2020
20 Mountain	POET INSTALLED	2/11/2020
21 Mountain	POET INSTALLED	1/21/2020
22 Mountain	POET INSTALLED	9/3/2020
29 Mountain	POET INSTALLED	2/24/2020
51 Mountain	POET INSTALLED	5/1/2020
54 Mountain	POET INSTALLED	6/2/2020
58 Mountain	POET INSTALLED	7/7/2020
64 Mountain	POET INSTALLED	2/18/2020
5 Prospect	POET INSTALLED	1/21/2020
12 Radford	POET INSTALLED	6/12/2020
15 Radford	NEEDS A POET	

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	Town Well (WELL-01G)			
		9/5/2019	9/27/2019	1/8/2020	6/23/2020
Well Depth (feet)					
Sampling Date					
<b>EPA 537.1 (ng/L)</b>					
Perfluorobutanesulfonic acid (PFBS)		26.9	17	31.9	16.1
Perfluorohexanoic acid (PFHxA)		ND(1.82)	ND (1.87)	2.86	1.48(I)
Perfluorohexanesulfonic acid (PFHxS)		94.4	78.1	168	81.7
Perfluoroheptanoic acid (PFHpA)		ND(1.82)	ND (1.87)	2.47	1.25(I)
Perfluorooctanoic acid (PFOA)		3.92	3.18	9.52	4.48
Perfluorooctanesulfonic acid (PFOS)		26.4	18.9	52.6	23.5
Perfluorononanoic acid (PFNA)		ND(1.82)	ND (1.87)	ND (1.84)	ND (1.90)
Perfluorodecanoic acid (PFDA)		ND(1.82)	ND (1.87)	ND (1.84)	ND (1.90)
N-EtFOSAA		ND(1.82)	ND (1.87)	ND (1.84)	ND (1.90)
Perfluoroundecanoic acid (PFUnA)		ND(1.82)	ND (1.87)	ND (1.84)	ND (1.90)
N-MeFOSAA		ND(1.82)	ND (1.87)	ND (1.84)	ND (1.90)
Perfluorododecanoic acid (PFDoA)		ND(1.82)	ND (1.87)	ND (1.84)	ND (1.90)
Perfluorotridecanoic acid (PFTrDA)		ND(1.82)	ND (1.87)	ND (1.84)	ND (1.90)
Perfluorotetradecanoic acid (PFTA)		ND(1.82)	ND (1.87)	ND (1.84)	ND (1.90)
Total (All Compounds)		151.6	117.2	264.9	127.1
Regulated Total	20	<b>124.7</b>	<b>100.2</b>	<b>230.1</b>	<b>110.3</b>

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Containment Level



**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	Mountain Rd Runoff
Well Depth (feet)		NA
Sampling Date		2/27/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		58
Perfluorohexanoic acid (PFHxA)		88
Perfluorohexanesulfonic acid (PFHxS)		710
Perfluoroheptanoic acid (PFHpA)		23
Perfluorooctanoic acid (PFOA)		100
Perfluorooctanesulfonic acid (PFOS)		2,800
Perfluorononanoic acid (PFNA)		3.1
Perfluorodecanoic acid (PFDA)		6.2
N-EtFOSAA		3.1
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		3.9
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		3795.3
Regulated Total	20	3642.3

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Containment Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	9 Allen Hill Rd	
		2/12/2020	7/23/2020
Well Depth (feet)			
Sampling Date			
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	12 Allen Hill Rd	
		2/14/2020	7/27/2020
Well Depth (feet)			
Sampling Date			
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		2.2	ND (2.0)
Perfluorooctanoic acid (PFOA)		5.8	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		4.2	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		12.2	ND (2.0)
Regulated Total	20	12.2	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	15 Allen Hill Rd
Well Depth (feet)		Unknown
Sampling Date		4/28/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	19 Allen Hill Rd
Well Depth (feet)		Unknown
Sampling Date		4/28/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	20 Allen Hill Rd
Well Depth (feet)		400
Sampling Date		5/8/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		3
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		2.3
Perfluorooctanoic acid (PFOA)		3
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		8.3
Regulated Total	20	5.3

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	32 Allen Hill Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/2/2020	7/22/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 PFAS Drinking Water Summary  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	7 Boylston Ave																		
		-			-			Not Recorded			14,911			23,425			32,192			
		3/27/2020			3/1/2020			3/17/2020			5/1/2020			6/18/2020			7/29/2020			
Flow Meter Reading (gallons)																				
Sampling Date																				
			DUPLICATE	FIELD BLANK	POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF
<b>EPA 537.1 (ng/L)</b>																				
Perfluorobutanesulfonic acid (PFBS)		3.6	3.7	ND (2.0)		4.1	ND (2.0)	ND (2.0)	2.2	ND (2.0)	ND (2.0)	4.3	ND (2.0)	ND (2.0)	4.1	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		16	17	ND (2.0)		20	ND (2.0)	ND (2.0)	12	ND (2.0)	ND (2.0)	22	ND (2.0)	ND (2.0)	23	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		2.7	ND (2.0)	14		2.8	ND (2.0)	ND (2.0)	2.5	ND (2.0)	ND (2.0)	2.7	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		4.5	6.2	4.7		6.2	ND (2.0)	ND (2.0)	3.3	ND (2.0)	ND (2.0)	4.9	ND (2.0)	ND (2.0)	4.1	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTriDA)		ND (2.0)	ND (2.0)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTTA)		ND (2.0)	ND (2.0)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		26.8	26.9	18.7		33.1	ND (2.0)	ND (2.0)	20.0	ND (2.0)	ND (2.0)	33.9	ND (2.0)	ND (2.0)	31.2	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Regulated Total	20	<b>23.2</b>	<b>23.2</b>	<b>18.7</b>		<b>29.0</b>	ND (2.0)	ND (2.0)	<b>17.8</b>	ND (2.0)	ND (2.0)	<b>29.6</b>	ND (2.0)	ND (2.0)	<b>27.1</b>	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level



TABLE 1  
 PFAS Drinking Water Summary  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard &	12 Boylston Ave										
		-		4,939			9,900			13,469		
		1/10/2020	3/20/2020	5/1/2020			6/23/2020			7/31/2020		
		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	
<b>EPA 537.1 (ng/L)</b>												
Perfluorobutanesulfonic acid (PFBS)	9.1		7.5	ND (2.0)	ND (2.0)	8.9	ND (2.0)	ND (2.0)	7.7	ND (2.0)	ND (2.0)	
Perfluorohexanoic acid (PFHxA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	2.1	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorohexanesulfonic acid (PFHxS)	<b>14</b>		<b>14</b>	ND (2.0)	ND (2.0)	<b>18</b>	ND (2.0)	ND (2.0)	<b>17</b>	ND (2.0)	ND (2.0)	
Perfluoroheptanoic acid (PFHpA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorooctanoic acid (PFOA)	5.7		5.9	ND (2.0)	ND (2.0)	6.8	ND (2.0)	ND (2.0)	4.7	ND (2.0)	ND (2.0)	
Perfluorooctanesulfonic acid (PFOS)	6.4		5.7	ND (2.0)	ND (2.0)	6.4	ND (2.0)	ND (2.0)	5.9	ND (2.0)	ND (2.0)	
Perfluorononanoic acid (PFNA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorodecanoic acid (PFDA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
N-EtFOSAA	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluoroundecanoic acid (PFUnA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
N-MeFOSAA	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorododecanoic acid (PFDoA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorotridecanoic acid (PFTDA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorotetradecanoic acid (PFTA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Total (All Compounds)	35.2		33.1	ND (2.0)	ND (2.0)	42.2	ND (2.0)	ND (2.0)	35.3	ND (2.0)	ND (2.0)	
Regulated Total	<b>20</b>		<b>26.1</b>	<b>25.6</b>	ND (2.0)	<b>31.2</b>	ND (2.0)	ND (2.0)	<b>27.6</b>	ND (2.0)	ND (2.0)	

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	13 Boylston Ave	
		~100'	
Well Depth (feet)			
Sampling Date		1/8/2020	5/28/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	16 Boylston Ave	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		1/9/2020	5/28/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		5.3	6.2
Perfluorohexanoic acid (PFHxA)		3.7	3.9
Perfluorohexanesulfonic acid (PFHxS)		4.7	5.2
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		8	8.9
Perfluorooctanesulfonic acid (PFOS)		7.2	5.5
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		28.9	29.7
Regulated Total	20	19.9	19.6

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	17 Boylston Ave	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		1/8/2020	5/28/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	21 Boylston Ave	
		2/19/2020	7/22/2020
Well Depth (feet)			
Sampling Date			
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	24 Boylston Ave	
		~200'	
Well Depth (feet)			
Sampling Date		1/9/2020	5/29/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	32 Boylston Ave
Well Depth (feet)		
Sampling Date		5/28/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		3.7
Perfluorooctanesulfonic acid (PFOS)		2.9
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		6.6
Regulated Total	20	6.6

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	40 Boylston Ave
Well Depth (feet)		
Sampling Date		4/28/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		5.3
Perfluorooctanesulfonic acid (PFOS)		3.9
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		9.2
Regulated Total	20	9.2

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level



**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	6 Connor Lane
Well Depth (feet)		
Sampling Date		8/31/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	4 Goodnow Rd
Well Depth (feet)		
Sampling Date		4/28/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	9 Gregory Rd
Well Depth (feet)		UNKNOWN
Sampling Date		2/1/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	11 Gregory Hill Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		1/22/2020	5/29/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	13 Gregory Hill Rd		
		UNKNOWN		
Well Depth (feet)				
Sampling Date		1/22/2020	5/29/2020	
				<b>DUPLICATE</b>
<b>EPA 537.1 (ng/L)</b>				
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)	ND (2.0)

NOTES:  
Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
ND = Not detected above the lab reporting limits shown in parentheses.  
Bolded values exceed the proposed Method 1 Standard  
MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	14 Gregory Hill Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		1/9/2020	5/29/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		2.6	2.9
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		3.7	5.2
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		3.2	3.4
Perfluorooctanesulfonic acid (PFOS)		2.5	2.7
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		12	14.2
Regulated Total	20	9.4	11.3

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 PFAS Drinking Water Summary  
 Princeton, Massachusetts  
 RTN 2-21072

Flow Meter Reading (gallons) Sampling Date	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	15 Gregory Hill Rd									
		5,368			68,471			104,009			
		1/13/2020	2/26/2020	3/11/2020	6/23/2020	7/31/2020					
		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF
<b>EPA 537.1 (ng/L)</b>											
Perfluorobutanesulfonic acid (PFBS)		2.7	3.6	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		2.9	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		5.2	6.6	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		4.7	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		5.1	2.2	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		5.4	5.4	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		26	17.8	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Regulated Total	20	20.4	14.2	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	21 Gregory Hill Rd	
		2/28/2020	9/18/2020
Well Depth (feet)			
Sampling Date		2/28/2020	9/18/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level



**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	44 Gregory Hill Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/5/2020	7/22/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 PFAS Drinking Water Summary  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	1 Hubbardston Rd														
		865			1,311			3,896			6,577					
		1/8/2020	2/26/2020	3/11/2020	5/1/2020	5/1/2020	5/1/2020	6/18/2020	6/18/2020	6/18/2020	7/29/2020	7/29/2020	7/29/2020	7/29/2020	7/29/2020	
		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF		
<i>EPA 537.1 (ng/L)</i>																
Perfluorobutanesulfonic acid (PFBS)	7		5.7	ND (2.0)	ND (2.0)	6.4	ND (2.0)	ND (2.0)	6.5	ND (2.0)	ND (2.0)	6.4	ND (2.0)	ND (2.0)		
Perfluorohexanoic acid (PFHxA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)		
Perfluorohexanesulfonic acid (PFHxS)	22		15	ND (2.0)	ND (2.0)	21	ND (2.0)	ND (2.0)	24	ND (2.0)	ND (2.0)	23	ND (2.0)	ND (2.0)		
Perfluoroheptanoic acid (PFHpA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)		
Perfluorooctanoic acid (PFOA)	3.4		3	ND (2.0)	ND (2.0)	3.1	ND (2.0)	ND (2.0)	2.9	ND (2.0)	ND (2.0)	2.9	ND (2.0)	ND (2.0)		
Perfluorooctanesulfonic acid (PFOS)	6.1		5.6	ND (2.0)	ND (2.0)	5.7	ND (2.0)	ND (2.0)	6.2	ND (2.0)	ND (2.0)	5.6	ND (2.0)	ND (2.0)		
Perfluorononanoic acid (PFNA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)		
Perfluorodecanoic acid (PFDA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)		
N-EtFOSAA	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)		
Perfluoroundecanoic acid (PFUnA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)		
N-MeFOSAA	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)		
Perfluorododecanoic acid (PFDoA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)		
Perfluorotridecanoic acid (PFTriDA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)		
Perfluorotetradecanoic acid (PFTA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)		
Total (All Compounds)	38.5		33.3	ND (2.0)	ND (2.0)	36.2	ND (2.0)	ND (2.0)	39.6	ND (2.0)	ND (2.0)	37.9	ND (2.0)	ND (2.0)		
Regulated Total	20		31.5	ND (2.0)	ND (2.0)	29.8	ND (2.0)	ND (2.0)	33.1	ND (2.0)	ND (2.0)	31.5	ND (2.0)	ND (2.0)		

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 POET System Monitoring  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	5 Hubbardston Road														
		12/5/2019			1/28/2020			2/5/2020			3/5/2020			5/1/2020		
		INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF			
Flow Meter Reading (gallons)		-	-	1,131			5,143			11,960						
Sampling Date		12/5/2019	1/28/2020	2/5/2020			3/5/2020			5/1/2020						
Notes			POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF				
<b>EPA 537.1 (ng/L)</b>																
Perfluorobutanesulfonic acid (PFBS)		8.4		6.3	ND (2.0)	ND (2.0)	4.3	ND (2.0)	ND (2.0)	4.6	ND (2.0)	ND (2.0)				
Perfluorohexanoic acid (PFHxA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)				
Perfluorohexanesulfonic acid (PFHxS)		29		25	ND (2.0)	ND (2.0)	11	ND (2.0)	ND (2.0)	15	ND (2.0)	ND (2.0)				
Perfluoroheptanoic acid (PFHpA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)				
Perfluorooctanoic acid (PFOA)		2.9		2.5	ND (2.0)	ND (2.0)	2.7	ND (2.0)	ND (2.0)	2.9	ND (2.0)	ND (2.0)				
Perfluorooctanesulfonic acid (PFOS)		7.3		6.9	ND (2.0)	ND (2.0)	4.9	ND (2.0)	ND (2.0)	4.8	ND (2.0)	ND (2.0)				
Perfluorononanoic acid (PFNA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)				
Perfluorodecanoic acid (PFDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)				
N-EtFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)				
Perfluoroundecanoic acid (PFUnA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)				
N-MeFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)				
Perfluorododecanoic acid (PFDoA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)				
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)				
Perfluorotetradecanoic acid (PFTA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)				
Total (All Compounds)		47.6		40.7	ND (2.0)	ND (2.0)	22.9	ND (2.0)	ND (2.0)	27.3	ND (2.0)	ND (2.0)				
Regulated Total	20	<b>39.2</b>		<b>34.4</b>	ND (2.0)	ND (2.0)	<b>18.6</b>	ND (2.0)	ND (2.0)	<b>22.7</b>	ND (2.0)	ND (2.0)				

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	5 Hubbardston Road					
		6/30/2020			8/5/2020		
		INF	MID	EFF	INF	MID	EFF
Flow Meter Reading (gallons)		22,710			27,069		
Sampling Date		6/30/2020			8/5/2020		
Notes							
<b>EPA 537.1 (ng/L)</b>							
Perfluorobutanesulfonic acid (PFBS)		4.6	ND (2.0)	ND (2.0)	7	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		17	ND (2.0)	ND (2.0)	27	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		2.6	ND (2.0)	ND (2.0)	2.5	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		5.5	ND (2.0)	ND (2.0)	6.7	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		29.7	ND (2.0)	ND (2.0)	43.2	ND (2.0)	ND (2.0)
Regulated Total	20	<b>25.1</b>	ND (2.0)	ND (2.0)	<b>36.2</b>	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	7 Hubbardston Rd	
		400'	
Well Depth (feet)			
Sampling Date		12/5/2019	6/5/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		2.3	3.1
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		3.5	5.8
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		2.9	2.4
Perfluorooctanesulfonic acid (PFOS)		3.3	3.5
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		12	14.8
Regulated Total	20	9.7	11.7

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 POET System Monitoring  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	15 Hubbardston Road													
		-	-	Not Recorded			3,771			6,855			8,913		
		12/5/2019	2/11/2020	2/26/2020			5/1/2020			6/18/2020			7/30/2020		
Notes		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	
<i>EPA 537.1 (ng/L)</i>															
Perfluorobutanesulfonic acid (PFBS)		27		17	ND (2.0)	ND (2.0)	21	ND (2.0)	ND (2.0)	21	ND (2.0)	ND (2.0)	20	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		110		73	ND (2.0)	ND (2.0)	95	ND (2.0)	ND (2.0)	90	ND (2.0)	ND (2.0)	92	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		4.6		3.5	ND (2.0)	ND (2.0)	4.2	ND (2.0)	ND (2.0)	3	ND (2.0)	ND (2.0)	3.9	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		18		14	ND (2.0)	ND (2.0)	21	ND (2.0)	ND (2.0)	18	ND (2.0)	ND (2.0)	19	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTTrDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTTA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		159.6		107.5	ND (2.0)	ND (2.0)	141.2	ND (2.0)	ND (2.0)	132.0	ND (2.0)	ND (2.0)	134.9	ND (2.0)	ND (2.0)
Regulated Total	20	<b>132.6</b>		<b>90.5</b>	ND (2.0)	ND (2.0)	<b>120.2</b>	ND (2.0)	ND (2.0)	<b>111.0</b>	ND (2.0)	ND (2.0)	<b>114.9</b>	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 PFAS Drinking Water Summary  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	19 Hubbardston Rd					
		-	-	-	Not Recorded		
		12/5/2019		2/26/2020	6/5/2020		
			POET INSTALLED	EFFLUENT ONLY	INF	MID	EFF
<b>EPA 537.1 (ng/L)</b>							
Perfluorobutanesulfonic acid (PFBS)		2.9		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		9.7		ND (2.0)	5.8	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		12.6		ND (2.0)	5.8	ND (2.0)	ND (2.0)
Regulated Total	20	9.7		ND (2.0)	5.8	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	23 Hubbardston Rd		
		UNKNOWN		
Well Depth (feet)				
Sampling Date		1/10/2020	1/27/2020	5/29/2020
<b>EPA 537.1 (ng/L)</b>				
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		4.9	5.0	4.1
Perfluorooctanesulfonic acid (PFOS)		4.1	3.7	3.3
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		9.0	8.7	7.4
Regulated Total	20	9.0	8.7	7.4

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	33 Hubbardston Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/5/2020	7/23/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	2.1
Perfluorooctanesulfonic acid (PFOS)		2.5	2.1
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		2.5	4.2
Regulated Total	20	2.5	4.2

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level



**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	35 Hubbardston Rd
Well Depth (feet)		
Sampling Date		
<b><i>EPA 537.1 (ng/L)</i></b>		
Perfluorobutanesulfonic acid (PFBS)		
Perfluorohexanoic acid (PFHxA)		
Perfluorohexanesulfonic acid (PFHxS)		
Perfluoroheptanoic acid (PFHpA)		
Perfluorooctanoic acid (PFOA)		
Perfluorooctanesulfonic acid (PFOS)		
Perfluorononanoic acid (PFNA)		
Perfluorodecanoic acid (PFDA)		
N-EtFOSAA		
Perfluoroundecanoic acid (PFUnA)		
N-MeFOSAA		
Perfluorododecanoic acid (PFDoA)		
Perfluorotridecanoic acid (PFTrDA)		
Perfluorotetradecanoic acid (PFTA)		
Total (All Compounds)		
Regulated Total	20	

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	36 Hubbardston Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/6/2020	7/22/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	5.4
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	5.0
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	10.4
Regulated Total	20	ND (2.0)	10.4

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	42 Hubbardston Rd		
		2/10/2020	7/23/2020	
Well Depth (feet)				
Sampling Date				
				<b>DUPLICATE</b>
<b>EPA 537.1 (ng/L)</b>				
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	7.8	7.2
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	7.9	8.5
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	15.7	15.7
Regulated Total	20	ND (2.0)	15.7	15.7

NOTES:  
Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
ND = Not detected above the lab reporting limits shown in parentheses.  
Bolded values exceed the proposed Method 1 Standard  
MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 PFAS Drinking Water Summary  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed	43 Hubbardston										
				2,655			4,953			7,349		
		12/12/2019	3/20/2020	5/8/2020			6/23/2020			7/31/2020		
Flow Meter Reading (gallons)												
Sampling Date												
			POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF
<b>EPA 537.1 (ng/l)</b>												
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		3.5		3.1	ND (2.0)	ND (2.0)	3.1	ND (2.0)	ND (2.0)	2.9	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		4.4		4.4	ND (2.0)	ND (2.0)	4.6	ND (2.0)	ND (2.0)	4.5	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		15		15	ND (2.0)	ND (2.0)	15	ND (2.0)	ND (2.0)	14	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		10		10	ND (2.0)	ND (2.0)	12	ND (2.0)	ND (2.0)	9.9	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		33		32.5	ND (2.0)	ND (2.0)	34.7	ND (2.0)	ND (2.0)	31.3	ND (2.0)	ND (2.0)
Regulated Total	20	<b>29</b>		<b>29.4</b>	ND (2.0)	ND (2.0)	<b>31.6</b>	ND (2.0)	ND (2.0)	<b>28.4</b>	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	44 Hubbardston Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/10/2020	7/23/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (4.0)	ND (4.0)
Perfluorohexanoic acid (PFHxA)		ND (4.0)	2.2
Perfluorohexanesulfonic acid (PFHxS)		ND (4.0)	ND (4.0)
Perfluoroheptanoic acid (PFHpA)		ND (4.0)	2.1
Perfluorooctanoic acid (PFOA)		ND (4.0)	7.1
Perfluorooctanesulfonic acid (PFOS)		ND (4.0)	5.6
Perfluorononanoic acid (PFNA)		ND (4.0)	ND (4.0)
Perfluorodecanoic acid (PFDA)		ND (4.0)	ND (4.0)
N-EtFOSAA		ND (4.0)	ND (4.0)
Perfluoroundecanoic acid (PFUnA)		ND (4.0)	ND (4.0)
N-MeFOSAA		ND (4.0)	ND (4.0)
Perfluorododecanoic acid (PFDoA)		ND (4.0)	ND (4.0)
Perfluorotridecanoic acid (PFTrDA)		ND (4.0)	ND (4.0)
Perfluorotetradecanoic acid (PFTA)		ND (4.0)	ND (4.0)
Total (All Compounds)		ND (4.0)	17
Regulated Total	20	ND (4.0)	14.8

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	46 Hubbardston Rd	
		2/12/2020	7/23/2020
Well Depth (feet)			
Sampling Date			
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	2.2
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	2.4
Perfluorooctanoic acid (PFOA)		6.2	8.8
Perfluorooctanesulfonic acid (PFOS)		6	6.2
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		12.2	19.6
Regulated Total	20	12.2	17.4

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	48 Hubbardston Rd	
		2/12/2020	7/23/2020
Well Depth (feet)			
Sampling Date			
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	52 Hubbardston Rd	
		2/12/2020	9/18/2020
Well Depth (feet)			
Sampling Date		2/12/2020	9/18/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level



**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	73 Hubbardston Rd
Well Depth (feet)		UNKNOWN
Sampling Date		6/11/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	81 Hubbardston Rd
Well Depth (feet)		500
Sampling Date		4/28/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	57 Merriam Rd	
		UNKNOWN	
Well Depth (feet)		UNKNOWN	
Sampling Date		4/28/2020	4/28/2020
			<b>EFF</b>
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		2.5	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		4.3	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		6.8	ND (2.0)
Regulated Total	20	6.8	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	59 Merriam Rd
Well Depth (feet)		UNKNOWN
Sampling Date		4/28/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	70 Merriam Rd
Well Depth (feet)		167
Sampling Date		4/28/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	85 Merriam Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/26/2020	7/22/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		4.1	5.1
Perfluorooctanesulfonic acid (PFOS)		2.7	2.9
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		6.8	8.0
Regulated Total	20	6.8	8.0

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	105 Merriam Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/28/2020	7/21/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	2 Mountain Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		1/7/2020	6/5/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	2.1
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	2.1
Regulated Total	20	ND (2.0)	2.1

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level



TABLE 1  
 POET System Monitoring  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	6 Mountain Road															
		1,557			Not Recorded			20,718			25,830			31,079			
		12/5/2019	1/28/2020	2/5/2020	3/5/2020			5/8/2020			6/23/2020			7/29/2020			
Notes	POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	
<i>EPA 537.1 (ng/L)</i>																	
Perfluorobutanesulfonic acid (PFBS)		8.4	3.7	ND (2.0)	ND (2.0)	5.8	ND (2.0)	ND (2.0)	4.3	ND (2.0)	ND (2.0)	4.1	ND (2.0)	ND (2.0)	3.7	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	2.5	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		23	12	ND (2.0)	ND (2.0)	17	ND (2.0)	ND (2.0)	14	ND (2.0)	ND (2.0)	16	ND (2.0)	ND (2.0)	13	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		2.4	2.1	ND (2.0)	ND (2.0)	2.5	ND (2.0)	ND (2.0)	2.5	ND (2.0)	ND (2.0)	8.2	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		4.7	4.1	ND (2.0)	ND (2.0)	5	ND (2.0)	ND (2.0)	4	ND (2.0)	ND (2.0)	11	ND (2.0)	ND (2.0)	3.5	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	3.2	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTriDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		38.5	21.9	ND (2.0)	ND (2.0)	30.3	ND (2.0)	ND (2.0)	24.8	ND (2.0)	ND (2.0)	45.0	ND (2.0)	ND (2.0)	20.2	ND (2.0)	ND (2.0)
Regulated Total	20	30.1	18.2	ND (2.0)	ND (2.0)	24.5	ND (2.0)	ND (2.0)	20.5	ND (2.0)	ND (2.0)	38.4	ND (2.0)	ND (2.0)	16.5	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	10 Mountain Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		12/5/2019	6/11/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	2.5
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	4.5
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	3.4
Perfluorooctanesulfonic acid (PFOS)		2.0	3.0
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		2.0	13.4
Regulated Total	20	2.0	10.9

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	14 Mountain Rd		
		500'		
Well Depth (feet)				
Sampling Date		1/9/2020	1/22/2020	5/29/2020
<i>EPA 537.1 (ng/L)</i>				
Perfluorobutanesulfonic acid (PFBS)		7.4	8.7	7.8
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		30	35	33
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		2.6	2.3	3.3
Perfluorooctanesulfonic acid (PFOS)		6.1	7.8	7
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTTrDA)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		46.1	53.8	51.1
Regulated Total	20	<b>38.7</b>	<b>45.1</b>	<b>43.3</b>

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**POET System Monitoring**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	18 Mountain Road										
		229			1,237			5,737				
		1/10/2020	2/11/2020	2/14/2020	3/11/2020	3/11/2020	3/11/2020	5/1/2020	5/1/2020	5/1/2020		
Notes		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	
<b>EPA 537.1 (ng/L)</b>												
Perfluorobutanesulfonic acid (PFBS)		25		20	ND (2.0)	ND (2.0)	27	ND (2.0)	ND (2.0)	15	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		3.4		2.8	ND (2.0)	ND (2.0)	3.1	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		150		110	ND (2.0)	ND (2.0)	160	ND (2.0)	ND (2.0)	88	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		6.4		5.6	ND (2.0)	ND (2.0)	6.4	ND (2.0)	ND (2.0)	4.9	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		61.0		50	ND (2.0)	ND (2.0)	61	ND (2.0)	ND (2.0)	36	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		245.8		188.4	ND (2.0)	ND (2.0)	257.5	ND (2.0)	ND (2.0)	143.9	ND (2.0)	ND (2.0)
Regulated Total	20	<b>217.4</b>		<b>165.6</b>	ND (2.0)	ND (2.0)	<b>227.4</b>	ND (2.0)	ND (2.0)	<b>128.9</b>	ND (2.0)	ND (2.0)

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	18 Mountain Rd					
		11,780			20,025		
		6/18/2020			7/29/2020		
Notes	INF	MID	EFF	INF	MID	EFF	
<b>EPA 537.1 (ng/L)</b>							
Perfluorobutanesulfonic acid (PFBS)		7.9	ND (2.0)	ND (2.0)	6.8	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		44	ND (2.0)	ND (2.0)	42	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		3.1	ND (2.0)	ND (2.0)	2.4	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		24	ND (2.0)	ND (2.0)	21	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		79.0	ND (2.0)	ND (2.0)	72.2	ND (2.0)	ND (2.0)
Regulated Total	20	<b>71.1</b>	ND (2.0)	ND (2.0)	<b>65.4</b>	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**POET System Monitoring**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	19 Mountain Rd													
		NA			400			6,533			12,367				
		12/4/2019	1/10/2020	1/10/2020	1/17/2020	1/17/2020	1/17/2020	1/31/2020	1/31/2020	1/31/2020	3/3/2020	3/3/2020	3/3/2020		
Notes		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	
<b>EPA 537.1 (ng/L)</b>															
Perfluorobutanesulfonic acid (PFBS)		32		9.2	ND (2.0)	ND (2.0)	28	ND (2.0)	ND (2.0)	6.3	ND (2.0)	ND (2.0)	7.1	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		5.1		ND (2.0)	ND (2.0)	ND (2.0)	4.4	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		220		58	ND (2.0)	ND (2.0)	190	ND (2.0)	ND (2.0)	38	ND (2.0)	ND (2.0)	39	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		2.5		ND (2.0)	ND (2.0)	ND (2.0)	2.3	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		11		3.5	ND (2.0)	ND (2.0)	8.9	ND (2.0)	ND (2.0)	3	ND (2.0)	ND (2.0)	3.1	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		190		48	ND (2.0)	ND (2.0)	140	ND (2.0)	ND (2.0)	32	ND (2.0)	ND (2.0)	28	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTa)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		460.6		118.7	ND (2.0)	ND (2.0)	373.6	ND (2.0)	ND (2.0)	79.3	ND (2.0)	ND (2.0)	77.2	ND (2.0)	ND (2.0)
Regulated Total	20	<b>421</b>		<b>109.5</b>	ND (2.0)	ND (2.0)	<b>341.2</b>	ND (2.0)	ND (2.0)	<b>73</b>	ND (2.0)	ND (2.0)	<b>70.1</b>	ND (2.0)	ND (2.0)

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	19 Mountain Rd											
		25,926			32,780			40,864					
		5/8/2020	6/18/2020	6/18/2020	7/29/2020	7/29/2020	7/29/2020						
Notes	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	
<b>EPA 537.1 (ng/L)</b>													
Perfluorobutanesulfonic acid (PFBS)		11	ND (2.0)	ND (2.0)	42	ND (2.0)	ND (2.0)	12	ND (2.0)	ND (2.0)			
Perfluorohexanoic acid (PFHxA)		2.6	ND (2.0)	ND (2.0)	8	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)			
Perfluorohexanesulfonic acid (PFHxS)		71	ND (2.0)	ND (2.0)	350	ND (2.0)	ND (2.0)	80	ND (2.0)	ND (2.0)			
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)	3.7	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)			
Perfluorooctanoic acid (PFOA)		4.2	ND (2.0)	ND (2.0)	12	ND (2.0)	ND (2.0)	4	ND (2.0)	ND (2.0)			
Perfluorooctanesulfonic acid (PFOS)		44	ND (2.0)	ND (2.0)	230	ND (2.0)	ND (2.0)	55	ND (2.0)	ND (2.0)			
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)			
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)			
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)			
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)			
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)			
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)			
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)			
Perfluorotetradecanoic acid (PFTa)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)			
Total (All Compounds)		132.8	ND (2.0)	ND (2.0)	645.7	ND (2.0)	ND (2.0)	151.0	ND (2.0)	ND (2.0)			
Regulated Total	20	<b>119.2</b>	ND (2.0)	ND (2.0)	<b>595.7</b>	ND (2.0)	ND (2.0)	<b>139.0</b>	ND (2.0)	ND (2.0)			

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**POET System Monitoring**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	20 Mountain Road														
		-			295			-			13,640			16,740		
		1/10/2020	2/11/2020	2/14/2020	3/17/2020	6/18/2020	7/29/2020									
Notes		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF		
<i>EPA 537.1 (ng/L)</i>																
Perfluorobutanesulfonic acid (PFBS)		12		14	ND (2.0)	ND (2.0)	15	ND (2.0)	ND (2.0)	19	ND (2.0)	ND (2.0)	18	ND (2.0)	ND (2.0)	
Perfluorohexanoic acid (PFHxA)		ND (2.0)		2.1	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	2.7	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorohexanesulfonic acid (PFHxS)		60		74	ND (2.0)	ND (2.0)	78	ND (2.0)	ND (2.0)	120	ND (2.0)	ND (2.0)	110	ND (2.0)	ND (2.0)	
Perfluoroheptanoic acid (PFHpA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorooctanoic acid (PFOA)		3.5		4.1	ND (2.0)	ND (2.0)	4.2	ND (2.0)	ND (2.0)	5.2	ND (2.0)	ND (2.0)	4.3	ND (2.0)	ND (2.0)	
Perfluorooctanesulfonic acid (PFOS)		22		28	ND (2.0)	ND (2.0)	30	ND (2.0)	ND (2.0)	44	ND (2.0)	ND (2.0)	44	ND (2.0)	ND (2.0)	
Perfluorononanoic acid (PFNA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorodecanoic acid (PFDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
N-EtFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluoroundecanoic acid (PFUnA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
N-MeFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorododecanoic acid (PFDoA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorotetradecanoic acid (PFTA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Total (All Compounds)		97.5		122.2	ND (2.0)	ND (2.0)	127.2	ND (2.0)	ND (2.0)	190.9	ND (2.0)	ND (2.0)	176.3	ND (2.0)	ND (2.0)	
Regulated Total	20	<b>86</b>		<b>106.1</b>	ND (2.0)	ND (2.0)	<b>112.2</b>	ND (2.0)	ND (2.0)	<b>169.2</b>	ND (2.0)	ND (2.0)	<b>158.3</b>	ND (2.0)	ND (2.0)	

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 POET System Monitoring  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	21 Mountain Rd													
		NA	NA	161			3,726			5,410			14,256		
Flow Meter Reading (gallons)				1/24/2020			1/31/2020			2/7/2020			3/17/2020		
Sampling Date		12/5/2020	1/21/2020												
Notes			POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF
<b>EPA 537.1 (ng/L)</b>															
Perfluorobutanesulfonic acid (PFBS)		8.2		7.5	ND (2.0)	ND (2.0)	5.5	ND (2.0)	ND (2.0)	4.3	ND (2.0)	ND (2.0)	7.4	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		2.4		2.0	ND (2.0)	ND (2.0)	2.2	ND (2.0)	ND (2.0)	3.2	ND (2.0)	ND (2.0)	3	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		53		47	ND (2.0)	ND (2.0)	37	ND (2.0)	ND (2.0)	28	ND (2.0)	ND (2.0)	46	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	2.1	ND (2.0)	ND (2.0)	3.2	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		5.4		4.6	ND (2.0)	ND (2.0)	5.7	ND (2.0)	ND (2.0)	5.4	ND (2.0)	ND (2.0)	4.7	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		44		37	ND (2.0)	ND (2.0)	35	ND (2.0)	ND (2.0)	26	ND (2.0)	ND (2.0)	35	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		113		98.1	ND (2.0)	ND (2.0)	85.4	ND (2.0)	ND (2.0)	69.0	ND (2.0)	ND (2.0)	99.3	ND (2.0)	ND (2.0)
Regulated Total	20	<b>102.4</b>		<b>88.6</b>	ND (2.0)	ND (2.0)	<b>77.7</b>	ND (2.0)	ND (2.0)	<b>61.5</b>	ND (2.0)	ND (2.0)	<b>88.9</b>	ND (2.0)	ND (2.0)

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	21 Mountain Rd								
		28,173			63,830			78,724		
Flow Meter Reading (gallons)		5/8/2020			6/30/2020			7/31/2020		
Sampling Date										
Notes		INF	MID	EFF						
<b>EPA 537.1 (ng/L)</b>										
Perfluorobutanesulfonic acid (PFBS)		4	ND (2.0)	ND (2.0)	4.5	ND (2.0)	ND (2.0)	5.6	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		2.4	ND (2.0)	ND (2.0)	2.2	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		25	ND (2.0)	ND (2.0)	29	ND (2.0)	ND (2.0)	37	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		5.4	ND (2.0)	ND (2.0)	5.0	ND (2.0)	ND (2.0)	4.5	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		21	ND (2.0)	ND (2.0)	24	ND (2.0)	ND (2.0)	25	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		57.8	ND (2.0)	ND (2.0)	64.7	ND (2.0)	ND (2.0)	72.1	ND (2.0)	ND (2.0)
Regulated Total	20	<b>51.4</b>	ND (2.0)	ND (2.0)	<b>58</b>	ND (2.0)	ND (2.0)	<b>66.5</b>	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	22 Mountain Rd				
		7/31/2020	9/3/2020	9/10/2020		
Flow Meter Reading (gallons)		-	-	544		
Sampling Date		7/31/2020	9/3/2020	9/10/2020		
			POET INSTALLED	INF	MID	EFF
<b>EPA 537.1 (ng/L)</b>						
Perfluorobutanesulfonic acid (PFBS)		86		9.8	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		8.7		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		490		55	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		3.7		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		16		2.3	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		180		25	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTTrDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		784.4		92.1	ND (2.0)	ND (2.0)
Regulated Total	20	<b>689.7</b>		<b>82.3</b>	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level



TABLE 1  
PFAS Drinking Water Summary  
Pittsford, Massachusetts  
RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	29 Mountain Rd																							
		-			-			-			3,090			-			5,301								
		1/8/2020			2/24/2020			3/11/2020			5/8/2020			6/5/2020			6/30/2020			7/14/2020			7/29/2020		
		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	EFF DUPLICATE	EFF	INF	MID	EFF	EFF	INF	MID	EFF								
<b>EPA 537.1 (ng/L)</b>																									
Perfluorobutanesulfonic acid (PFBS)	9.6	6.7	ND (2.0)	ND (2.0)	4	ND (2.0)	2.9	2	ND (2.0)	4.9	ND (2.0)	4.2	ND (2.0)	5.2	ND (2.0)	ND (2.0)									
Perfluorohexanoic acid (PFHxA)	2.5	2	ND (2.0)	ND (2.0)	2	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	2.1	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)									
Perfluorohexanesulfonic acid (PFHxS)	59	41	ND (2.0)	ND (2.0)	21	ND (2.0)	16	10	ND (2.0)	25	ND (2.0)	23	ND (2.0)	30	ND (2.0)	ND (2.0)									
Perfluorheptanoic acid (PFHpA)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)									
Perfluorooctanoic acid (PFOA)	5.1	5.1	ND (2.0)	ND (2.0)	4.4	ND (2.0)	3.5	2.2	ND (2.0)	4.7	ND (2.0)	4.5	ND (2.0)	3.8	ND (2.0)	ND (2.0)									
Perfluorooctanesulfonic acid (PFOS)	53	38	ND (2.0)	ND (2.0)	27	ND (2.0)	21	13	ND (2.0)	21	ND (2.0)	22	ND (2.0)	22	ND (2.0)	ND (2.0)									
Perfluorononanoic acid (PFNA)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)									
Perfluorodecanoic acid (PFDA)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)									
N-EFOSAA	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)									
Perfluoroundecanoic acid (PFUnA)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)									
N-MeFOSAA	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)									
Perfluorododecanoic acid (PFDoA)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)									
Perfluorotridecanoic acid (PFTriA)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)									
Perfluorotetradecanoic acid (PFTA)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)									
Total (All Compounds)	126.4	92.8	ND (2.0)	ND (2.0)	58.4	ND (2.0)	43.4	27.2	ND (2.0)	55.6	ND (2.0)	55.8	ND (2.0)	61.0	ND (2.0)	ND (2.0)									
Regulated Total	20	117.3	84.1	ND (2.0)	52.4	ND (2.0)	40.5	25.2	ND (2.0)	50.7	ND (2.0)	49.5	ND (2.0)	55.8	ND (2.0)	ND (2.0)									

NOTES:  
Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
ND = Not detected above the lab reporting limits shown in parentheses.  
Bolded values exceed the proposed Method 1 Standard  
MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	30 Mountain Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		1/27/2020	6/5/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		<2.0	<2.0
Perfluorohexanoic acid (PFHxA)		<2.0	<2.0
Perfluorohexanesulfonic acid (PFHxS)		4.4	3.9
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		6.1	4.6
Perfluorooctanesulfonic acid (PFOS)		5.4	4.1
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		15.9	12.6
Regulated Total	20	15.9	12.6

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	33 Mountain Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/7/2020	7/22/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	38 Mountain Rd	
		2/14/2020	7/21/2020
Well Depth (feet)			
Sampling Date			
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	3
Perfluorooctanesulfonic acid (PFOS)		2.2	2.4
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		2.2	5.4
Regulated Total	20	2.2	5.4

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 PFAS Drinking Water Summary  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	51 Mountain Rd											
		211					1,080			3,312			
		2/12/2020	5/1/2020	5/28/2020			6/23/2020			7/31/2020			
Flow Meter Reading (gallons)	-	-											
Sampling Date													
		POET INSTALLED	INF	MID	EFF	EFF DUPLICATE	INF	MID	EFF	INF	MID	EFF	
<i>EPA 537.1 (ng/l)</i>													
Perfluorobutanesulfonic acid (PFBS)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorohexanoic acid (PFHxA)		6.9	6.1	ND (2.0)	ND (2.0)	ND (2.0)	5.1	ND (2.0)	ND (2.0)	6.8	ND (2.0)	ND (2.0)	
Perfluorohexanesulfonic acid (PFHxS)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluoroheptanoic acid (PFHpA)		9.5	9.4	ND (2.0)	ND (2.0)	ND (2.0)	9.0	ND (2.0)	ND (2.0)	11	ND (2.0)	ND (2.0)	
Perfluorooctanoic acid (PFOA)		29	29	ND (2.0)	ND (2.0)	ND (2.0)	28	ND (2.0)	ND (2.0)	30	ND (2.0)	ND (2.0)	
Perfluorooctanesulfonic acid (PFOS)		24	23	ND (2.0)	2.9	ND (2.0)	21	ND (2.0)	ND (2.0)	24	ND (2.0)	ND (2.0)	
Perfluorononanoic acid (PFNA)		ND (4.0)	3	ND (2.0)	ND (2.0)	ND (2.0)	2.6	ND (2.0)	ND (2.0)	3.2	ND (2.0)	ND (2.0)	
Perfluorodecanoic acid (PFDA)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
N-EtFOSAA		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluoroundecanoic acid (PFUnA)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
N-MeFOSAA		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorododecanoic acid (PFDoA)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorotridecanoic acid (PFTrDA)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorotetradecanoic acid (PFTa)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Total (All Compounds)		69.4	70.5	ND (2.0)	2.9	ND (2.0)	65.7	ND (2.0)	ND (2.0)	75.0	ND (2.0)	ND (2.0)	
Regulated Total	20	<b>62.5</b>	<b>64.4</b>	ND (2.0)	2.9	ND (2.0)	<b>60.6</b>	ND (2.0)	ND (2.0)	<b>68.2</b>	ND (2.0)	ND (2.0)	

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 PFAS Drinking Water Summary  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	54 Mountain Rd										
				15,502			42,195			59,957		
		2/26/2020	6/2/2020	6/22/2020			8/5/2020			9/2/2020		
		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	
<b>EPA 537.1 (ng/L)</b>												
Perfluorobutanesulfonic acid (PFBS)		ND (4.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		5.2		5.0	ND (2.0)	ND (2.0)	4.2	ND (2.0)	ND (2.0)	4.3	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (4.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		7.6		7.9	ND (2.0)	ND (2.0)	6.7	ND (2.0)	ND (2.0)	7.4	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		20		24	ND (2.0)	ND (2.0)	23	ND (2.0)	ND (2.0)	24	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		18		24	ND (2.0)	ND (2.0)	22	ND (2.0)	ND (2.0)	21	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (4.0)		2.5	ND (2.0)	ND (2.0)	2.2	ND (2.0)	ND (2.0)	2.9	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (4.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (4.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (4.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (4.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (4.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTTrDA)		ND (4.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTTA)		ND (4.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		50.8		63.4	ND (2.0)	ND (2.0)	58.1	ND (2.0)	ND (2.0)	59.6	ND (2.0)	ND (2.0)
Regulated Total	20	<b>45.6</b>		<b>58.4</b>	ND (2.0)	ND (2.0)	<b>53.9</b>	ND (2.0)	ND (2.0)	<b>55.3</b>	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 PFAS Drinking Water Summary  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	58 Mountain Rd										
		2,131			8,428			22,138				
		2/26/2020	7/7/2020	7/14/2020	7/31/2020	7/31/2020	8/31/2020					
		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	
<b>EPA 537.1 (ng/L)</b>												
Perfluorobutanesulfonic acid (PFBS)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	15.0	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		19	19	ND (2.0)	ND (2.0)	3.6	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	28	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		29	31	ND (2.0)	ND (2.0)	6.0	ND (2.0)	ND (2.0)	ND (2.0)	94.0	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		89	95	ND (2.0)	ND (2.0)	18	ND (2.0)	ND (2.0)	ND (2.0)	270	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		210	230	ND (2.0)	ND (2.0)	35	ND (2.0)	ND (2.0)	ND (2.0)	19	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		20	20	ND (2.0)	ND (2.0)	3.5	ND (2.0)	ND (2.0)	ND (2.0)	5.7	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		6.2	6.9	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTTrDA)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (4.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		373.2	401.9	ND (2.0)	ND (2.0)	66.1	ND (2.0)	ND (2.0)	ND (2.0)	431.7	ND (2.0)	ND (2.0)
Regulated Total	20	<b>354.2</b>	<b>382.9</b>	ND (2.0)	ND (2.0)	<b>62.5</b>	ND (2.0)	ND (2.0)	ND (2.0)	<b>416.7</b>	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 PFAS Drinking Water Summary  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	64 Mountain Rd														
		-		Not Recorded				11,667			27,440			38,902		
		1/30/2020	2/18/2020	3/3/2020				5/8/2020			6/18/2020			7/29/2020		
		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF		
<i>EPA 537.1 (ng/L)</i>																
Perfluorobutanesulfonic acid (PFBS)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorohexanoic acid (PFHxA)	14		20	ND (2.0)	ND (2.0)	15	ND (2.0)	ND (2.0)	18	ND (2.0)	ND (2.0)	2	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorohexanesulfonic acid (PFHxS)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluoroheptanoic acid (PFHpA)	19		23	ND (2.0)	ND (2.0)	18	ND (2.0)	ND (2.0)	22	ND (2.0)	ND (2.0)	2.6	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorooctanoic acid (PFOA)	34		44	ND (2.0)	ND (2.0)	34	ND (2.0)	ND (2.0)	43	ND (2.0)	ND (2.0)	5.3	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorooctanesulfonic acid (PFOS)	22		20	ND (2.0)	ND (2.0)	15	ND (2.0)	ND (2.0)	20	ND (2.0)	ND (2.0)	2.4	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorononanoic acid (PFNA)	ND (2.0)		2.5	ND (2.0)	ND (2.0)	2.2	ND (2.0)	ND (2.0)	2.3	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorodecanoic acid (PFDA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
N-EtFOSAA	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluoroundecanoic acid (PFUnA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
N-MeFOSAA	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorododecanoic acid (PFDoA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorotridecanoic acid (PFTrDA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorotetradecanoic acid (PFTA)	ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Total (All Compounds)			89	109.5	ND (2.0)	ND (2.0)	84.2	ND (2.0)	ND (2.0)	105.3	ND (2.0)	ND (2.0)	12.4	ND (2.0)	ND (2.0)	
Regulated Total	20		75	89.5	ND (2.0)	ND (2.0)	69.2	ND (2.0)	ND (2.0)	87.3	ND (2.0)	ND (2.0)	10.3	ND (2.0)	ND (2.0)	

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level



**TABLE 1**  
**POET System Monitoring**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	5 Prospect Street														
		NA			127			182			188			47,737		
		1/13/2020	1/21/2020	1/24/2020	1/31/2020	1/31/2020	2/7/2020	2/7/2020	2/7/2020	6/18/2020	6/18/2020	6/18/2020				
Notes		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF		
<b>EPA 537.1 (ng/L)</b>																
Perfluorobutanesulfonic acid (PFBS)		9.4		2.4	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	2.4	ND (2.0)	ND (2.0)	
Perfluorohexanoic acid (PFHxA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorohexanesulfonic acid (PFHxS)		32		6.6	ND (2.0)	ND (2.0)	2.5	ND (2.0)	ND (2.0)	2.4	ND (2.0)	ND (2.0)	7	ND (2.0)	ND (2.0)	
Perfluoroheptanoic acid (PFHpA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorooctanoic acid (PFOA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorooctanesulfonic acid (PFOS)		6.2		3	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	2.8	ND (2.0)	ND (2.0)	
Perfluorononanoic acid (PFNA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorodecanoic acid (PFDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
N-EtFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluoroundecanoic acid (PFUnA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
N-MeFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorododecanoic acid (PFDoA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Perfluorotetradecanoic acid (PFTA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	
Total (All Compounds)		47.6		12.0	ND (2.0)	ND (2.0)	2.5	ND (2.0)	ND (2.0)	2.4	ND (2.0)	ND (2.0)	12.2	ND (2.0)	ND (2.0)	
Regulated Total	20	<b>38.2</b>		9.6	ND (2.0)	ND (2.0)	2.5	ND (2.0)	ND (2.0)	2.4	ND (2.0)	ND (2.0)	9.8	ND (2.0)	ND (2.0)	

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	5 Prospect Street					
		47,737			70,000		
		6/18/2020			7/27/2020		
Notes	INF	MID	EFF	INF	MID	EFF	
<b>EPA 537.1 (ng/L)</b>							
Perfluorobutanesulfonic acid (PFBS)		2.4	ND (2.0)	ND (2.0)	2.2	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		7	ND (2.0)	ND (2.0)	5.6	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		2.8	ND (2.0)	ND (2.0)	2.6	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		12.2	ND (2.0)	ND (2.0)	10.4	ND (2.0)	ND (2.0)
Regulated Total	20	9.8	ND (2.0)	ND (2.0)	8.2	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	7 Prospect St	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		12/9/2019	6/5/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		3.1	2.7
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		8.8	11
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		4.5	6
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		16.4	19.7
Regulated Total	20	13.3	17.0

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	11 Prospect St				
		~137'				
		1/8/2020	2/20/2020			9/10/2020
Well Depth (feet)			INF	MID	EFF	
Sampling Date						
<b>EPA 537.1 (ng/L)</b>						
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		2.1	3.3	ND (2.0)	ND (2.0)	3.4
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		2.3	2.5	ND (2.0)	ND (2.0)	3.7
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTTrDA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		4.4	5.8	ND (2.0)	ND (2.0)	7.1
Regulated Total	20	4.4	5.8	ND (2.0)	ND (2.0)	7.1

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	16 Prospect St	
		255'	
Well Depth (feet)		255'	
Sampling Date		1/22/2020	6/5/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	17 Prospect St	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		1/8/2020	6/5/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		2.8	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		2.8	ND (2.0)
Regulated Total	20	2.8	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	18 Prospect St	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		1/8/2020	6/5/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	21 Prospect St	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/5/2020	7/22/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	26 Prospect St	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/6/2020	7/23/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level



**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	41 Prospect St
Well Depth (feet)		UNKNOWN
Sampling Date		5/15/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	2 Radford Rd
Well Depth (feet)		
Sampling Date		2/19/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	7 Radford Rd	
		2/28/2020	7/21/2020
Well Depth (feet)			
Sampling Date			
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		2.3	3.2
Perfluorononanoic acid (PFNA)		ND (2.0)	2.7
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		2.3	5.9
Regulated Total	20	2.3	5.9

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	8 Radford Rd	
		2/28/2020	7/21/2020
Well Depth (feet)			
Sampling Date			
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		3.9	4.1
Perfluorooctanesulfonic acid (PFOS)		2.5	3.1
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		6.4	7.2
Regulated Total	20	6.4	7.2

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	11 Radford Rd	
		2/14/2020	7/22/2020
Well Depth (feet)			
Sampling Date		2/14/2020	7/22/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		2.7	3.1
Perfluorooctanesulfonic acid (PFOS)		2.3	3.1
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		5.0	6.2
Regulated Total	20	5.0	6.2

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

TABLE 1  
 PFAS Drinking Water Summary  
 Princeton, Massachusetts  
 RTN 2-21072

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	12 Radford Rd										
		-		879			1,943			3,465		
		5/1/2020	6/16/2020	6/30/2020			7/31/2020			8/31/2020		
Sampling Date		POET INSTALLED	INF	MID	EFF	INF	MID	EFF	INF	MID	EFF	
<i>EPA 537.1 (ng/l)</i>												
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		2.4		2.7	ND (2.0)	ND (2.0)	2.3	ND (2.0)	ND (2.0)	2.9	ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		3.2		3.2	ND (2.0)	ND (2.0)	3.3	ND (2.0)	ND (2.0)	4.2	ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		11		9.8	ND (2.0)	ND (2.0)	11	ND (2.0)	ND (2.0)	13	ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		8.3		7.5	ND (2.0)	ND (2.0)	8.9	ND (2.0)	ND (2.0)	8.5	ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTriDA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)		ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)	ND (2.0)
Total (All Compounds)		24.9		23.2	ND (2.0)	ND (2.0)	25.5	ND (2.0)	ND (2.0)	28.6	ND (2.0)	ND (2.0)
Regulated Total	20	<b>22.5</b>		<b>20.5</b>	ND (2.0)	ND (2.0)	<b>23.2</b>	ND (2.0)	ND (2.0)	<b>25.7</b>	ND (2.0)	ND (2.0)

NOTES:  
 Gray colored cells indicate those 6 compounds included in the regulated PFAS Total  
 ND = Not detected above the lab reporting limits shown in parentheses.  
 Bolded values exceed the proposed Method 1 Standard  
 MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	13 Radford Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		3/4/2020	7/21/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	15 Radford
Well Depth (feet)		
Sampling Date		9/18/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		3
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		4.3
Perfluorooctanoic acid (PFOA)		15
Perfluorooctanesulfonic acid (PFOS)		11
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		33.3
Regulated Total	20	<b>30.3</b>

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level



**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	18 Radford
Well Depth (feet)		
Sampling Date		9/18/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		5.2
Perfluorooctanesulfonic acid (PFOS)		4.3
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		9.5
Regulated Total	20	<b>9.5</b>

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	23 Radford Rd
Well Depth (feet)		
Sampling Date		7/22/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		2.2
Perfluorohexanesulfonic acid (PFHxS)		2.8
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		6.5
Perfluorooctanesulfonic acid (PFOS)		5.5
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		17.0
Regulated Total	20	14.8

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	28 Radford Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		1/30/2020	7/21/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		2.1	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		2.7	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		5.4	4.6
Perfluorooctanesulfonic acid (PFOS)		7	4.0
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		17.2	8.6
Regulated Total	20	15.1	8.6

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	29 Radford Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		3/17/2020	7/21/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		3.2	2.4
Perfluorooctanesulfonic acid (PFOS)		3.5	2.8
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		6.7	5.2
Regulated Total	20	6.7	5.2

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	33 Radford Rd
Well Depth (feet)		UNKNOWN
Sampling Date		5/29/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		ND (2.0)
Regulated Total	20	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	37 Radford Rd
Well Depth (feet)		70'
Sampling Date		4/28/2020
<b>EPA 537.1 (ng/L)</b>		
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		2.1
Perfluorononanoic acid (PFNA)		ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)
N-EtFOSAA		ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)
N-MeFOSAA		ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)
Total (All Compounds)		2.1
Regulated Total	20	2.1

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	1 Worcester Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		1/7/2020	6/11/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	2.5
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	2.5
Regulated Total	20	ND (2.0)	2.5

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	10 Worcester Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		1/9/2020	6/11/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		3.8	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		8	ND (2.0)
Perfluorooctanoic acid (PFOA)		3.6	3.0
Perfluorooctanesulfonic acid (PFOS)		2.3	ND (2.0)
Perfluorononanoic acid (PFNA)		2.7	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		20.4	3.0
Regulated Total	20	16.6	3.0

**NOTES:**

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level



**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	15 Worcester Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		3/6/2020	7/21/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		3.1	3.1
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		3.1	3.1
Regulated Total	20	3.1	3.1

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	16 Worcester Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/5/2020	7/29/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		2.2	2.6
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		2.2	2.6
Regulated Total	20	2.2	2.6

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	17 Worcester Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/10/2020	7/21/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	20 Worcester Rd	
		3/17/2020	7/21/2020
Well Depth (feet)			
Sampling Date			
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level

**TABLE 1**  
**PFAS Drinking Water Summary**  
**Princeton, Massachusetts**  
**RTN 2-21072**

Parameter	Massachusetts Contingency Plan GW-1 Standard & Proposed MMCL	23 Worcester Rd	
		UNKNOWN	
Well Depth (feet)			
Sampling Date		2/5/2020	7/21/2020
<b>EPA 537.1 (ng/L)</b>			
Perfluorobutanesulfonic acid (PFBS)		ND (2.0)	ND (2.0)
Perfluorohexanoic acid (PFHxA)		ND (2.0)	ND (2.0)
Perfluorohexanesulfonic acid (PFHxS)		ND (2.0)	ND (2.0)
Perfluoroheptanoic acid (PFHpA)		ND (2.0)	ND (2.0)
Perfluorooctanoic acid (PFOA)		ND (2.0)	ND (2.0)
Perfluorooctanesulfonic acid (PFOS)		ND (2.0)	ND (2.0)
Perfluorononanoic acid (PFNA)		ND (2.0)	ND (2.0)
Perfluorodecanoic acid (PFDA)		ND (2.0)	ND (2.0)
N-EtFOSAA		ND (2.0)	ND (2.0)
Perfluoroundecanoic acid (PFUnA)		ND (2.0)	ND (2.0)
N-MeFOSAA		ND (2.0)	ND (2.0)
Perfluorododecanoic acid (PFDoA)		ND (2.0)	ND (2.0)
Perfluorotridecanoic acid (PFTrDA)		ND (2.0)	ND (2.0)
Perfluorotetradecanoic acid (PFTA)		ND (2.0)	ND (2.0)
Total (All Compounds)		ND (2.0)	ND (2.0)
Regulated Total	20	ND (2.0)	ND (2.0)

NOTES:

Gray colored cells indicate those 6 compounds included in the regulated PFAS Total

ND = Not detected above the lab reporting limits shown in parentheses.

Bolded values exceed the proposed Method 1 Standard

MMCL is Massachusetts Maximum Contaminant Level